



ENVIRONMENT AUDIT REPORT



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)

Anand Nagar, Opp. Hataikheda Dam, BHEL, Bhopal, Madhya Pradesh - 462021

PREPARED BY

EMPIRICAL EXERGY PRIVATE LIMITED

No. 201, OM Apartment, 214 Indrapuri Colony, Bhawarkuan,

dudore – 452 001 (M. P.), India 0731-4948831, 7869327256

Email ID:eempirical18@gmail.com

www.eeplgroups.com (2021-23)

Fechnocrats Institute of Technology
(Excellence)
Anand Nagar, Bhopal

3 , 1

TIT(E)

BHOPAI

Chopal, M.S.





CONTENTS

Sr. No.	Items	Page No
1	Acknowledgment	3
II	Certificate of Accreditation	4
II **	Green Monitoring Committee	5
III	Environment Audit Team	7
IV	Energy and Environment Policy	8
V	Policy on Water Conservation	11
VI	Executive Summary	14
Chapter-1	Introduction	. 16
1.1	About Institute	16
1.2	About Environment Audit	20
1.3	Objective of Environment Audit	20
1.4	Target Areas of Environment Audit	20
1.5	Methodology Followed for Conducting Environment Audit	21
Chapter- 2	Water Consumption and Waste Water Sources	22
2.1	Details of Source Fresh Water and Uses Area	22
2.2	Water Accounting and Meter System	22
2.3	Fresh Water Flow Distribution Diagram	23
2.4	Water Storage Capacity in Institute	24
2.5	Water Uses Area in Institute	25
2.6	Water Cooler in Institute	26
2.7	Fresh Water Use in Watering in garden and lawn Area	26
2.8	Waste Water Generation Sources	28
Chapter- 3	Air Quality Measurement	29
3.1	Air Quality Measurement	. 29
Chapter- 4	Rain Water Harvesting System	34
4.1	Rain Water Harvesting System	34
4.2	Rain Water Harvesting System in Institute	35







ACKNOWLEDGEMENT

We would like to thank the Technocrats Institute of Technology (Excellence), Bhopal (M.P.). Our appreciation and gratitude to the management for granting us permission to conduct environment audit for the institute

We are genuinely touched by the helpful attitudes and cooperation displayed by all the faculty members and technical staff involved in the audit. Their valuable assistance and cooperation significantly contributed to the successful execution of the audit.

For- Empirical Exergy Private Limited



Rajesh Kumar Singadiya

(Director)

M.Tech (Energy Management),

Accredited Energy Auditor [AEA-0284]

Certified Energy Auditor [CEA-7271]

(BEE, Ministry of Power, Govt. of India)

Empanelled Energy Auditor with MPUVN, Bhopal M.P.

Lead Auditor ISO5000 :2011 [EnMS) from FICCI, Delhi

Entified Water Audien (NPC, Govt. of India)

hartered Engineer [1] 1699118], The Institution of Engineers (India)

tember of ISHRATET 81501

Bhopal. C

Anand Nagar, Bhopal





CERTIFICATE OF ACCREDITATION



BUREAU OF ENERGY EFFICIENCY

EA-7271 Examination Registration No.:

Accreditation Registration No.: AEA-284



Certificate of Accreditation

office athas been given accreditation as accredited energy auditor. The certificate shall be effective from .9th day of .May, 2018

The certificate is subject to the provisions of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

This certificate shall be valid until it is cancelled under regulation 9 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

On cancellation, the certificate of accreditation shall be surrendered to the Bureau within fifteen days from the date of receipt of order of cancellation.

Your name has been entered at AEA No...284... in the register of list of accredited energy auditors. Your name shall be liable to be struck out on the grounds specified in regulation 8 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

Given under the seal of the Bureau of Energy Efficiency, Ministry of Power, this 5" day of October, 2018

Bureau of Energy Efficiency

New Delhi







GREEN MONITORING COMMITTEE



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



ov Cibrichi Propulyogiki Vishwovidyolovic Bhops 131, Fr. No. 0765-2761801 foz-0758-2781477 website www

111E/Dic/2021/059

Circular

We are pleased to autounce the formation of a new committee dedicated to advancing our campus's sustamability efforts. The "Clean & Green Campus Initiatives Committee" that will focus on waste management and energy conservation strategies aimed at reducing our environmental footprint.

Committee Goals:

- Waste Management: Implementing effective recycling programs, reducing single-use plastics, and promoting sustainable practices across campus.
 Energy Management: Identifying apportunities for energy efficiency, promoting tenewable
- energy sources, and raising awareness about energy conservation.
- Rain Water Harvesting: Help reducing flooding, recharging groundwater resources. Provide a sustainable and environmentally friendly way to conserve water.
- Green Campus Management: Implementing environmental friendly practices and education combine to promote sustainable and eco-friendly practices in the campus

Members of the Committee:

	Name of Member	Designation
S.N.	Name of Memori	Chairman
1	Dr. Ravindra Gautam, Professor & Head, Civil Engineering	member
2	Dr. Ravindra Gautam, Professor & Head, Mechanical Engineering Dr. Adarsh Sachdeva, Professor & Head, Electrical Engineering	member
BANK WEST	C The Last A some A suff Professor of Field, Englished	member
4	Prof. Anii Solanki, Assistant Professor, Civil Engineering	-

Objectives:

- Conducting regular audits to assess current waste and energy usage.
- Developing and implementing action plans to achieve waste reduction and energy
- Collaborating with faculty, staff, and students to foster a culture of sustainability on campus.
- Organizing educational campaigns and events to raise awareness about environmental issues.



(Excellence)











TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



Abbrevied by AICTE Hew Dolle & Goyt of Modifyo Prodon Afficilies to Robert Goschi Procetyogsi Vistoravidyolova, Incop Februs, 1981, Bospel St., 79, No. 6755-2751601 fox 6755-2751317 website; ***

TITE/Dh/2022/064

10.07.2022

Circular With reference to the circular TTTE/Dir/2021/059, dt. 25.04.2021, we are reframing the "Clean & Green Campus Initiatives Committee" as follows.

Members of the Committee:

	St. CARambian	Designation
S.N.	Name of Member	Chairman
1	Dr. Ravindra Gautam, Professor & Head, Civil Engineering	member
2	Dr. Manish Joshi, Professor & Head, Mechanical Engineering	member
1957	Doof Galesh Sahn Assit Professor, Electrical Engineering	member
4	Prof. Pankaj Dixit. Assistant Professor, Civil Engineering	-1

Goals & objectives of the committee shall remain as follows.

Committee Goular

- 1. Waste Management: Implementing effective recycling programs, reducing single-use plastics, and promoting sustainable practices across campus.
- 2. Energy Management: Identifying opportunities for energy efficiency, promoting renewable energy sources, and raising awareness about energy conservation.
- 3. Rain Water Harvesting: Help reducing flooding, recharging groundwater resources. Provide a sustainable and environmentally friendly way to conserve water.
- 4. Green Campus Management: Implementing environmental friendly practices and education combine to promote sustainable and eco-friendly practices in the campus.

Objectives:

- Conducting regular audits to assess current waste and energy usage.
- . Developing and implementing action plans to achieve waste reduction and energy
- Collaborating with faculty, staff, and students to foster a culture of sustainability on campus. Organizing educational campaigns and events to raise awareness about environmental issues.

Director TIT Excellence Director s Institute of Technology (Excellence) Anusd Nagar, Bhopal



Technocrats Institute of Technology (Excellence) Anand Never Rhonal





ENVIRONMENT AUDIT TEAM

The audit team constituted by the following senior technical executives from the Empirical Exergy Private Limited,

- ♣ Mr. Rajesh Kumar Singadiya[Director & Accredited Energy Auditor AEA-0284]
- ₩ Ms. Laxmi Raikwar [Energy Expert and Report Reviewer]
- ♣ Mr. Ajay Nahra [Sr.Project Engineer]
- ₩ Mr. Charchit Pathak [Sr.Project Engineer]
- ₩ Mr. Mohan Choudhary [Electrical Engineer]
- Mr. Praveen Punasiya [Field Engineer]







ENERGY ENVIRONMENT POLICY



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



(Run by Chandravadani Mahila Shiksha Samiti, Bhopal) Appenyed by AICTE New Delhi & Govt of Madhya Prada Affiliated to Rajeev Gandhi Proudvagiki Vishwayaryakiya Biriped Post Platon, BHBC Bhopair 1, Ph. No.- 0755-2751801 Fast-0755-2751679 website from

Ref: TfT-E/Dir/2021/69

Date: 10/07/21

Office Order

histitute is committed for promoting environmental sustainability and reducing its conventional energy consumption. As decided in Board of Governance meeting (TIFE/2023/BOG/28), institute annuances the policy for ensuring accountability, compliance with regulations, and continuous improvement in sustainability offorts with following objectives.

Objectives

- * Evaluate the institute's progress in achieving its environmental and energy goals
- Identify mean for improvement in resource utilization (energy, water, waste)
- Ensure compliance with relevant environmental regulations
- Promote environmental awareness and responsibility among the institute communits
- Identify opportunities for cost-saving through improved resource management
- Identifying opportunities for improvement, and promoting sustainable practices

This policy establishes a framework for conducting regular audits to assess and improve the effectiveness of our environment and energy initiatives. This policy is in operation with immediate effect



Finel Policy in detail

- Huntile Chairperson for kind information
- Vice Principal/Deans
- All HODS All Concern Faculty
- Registrar Librarian

Nex co thered and institute Website



Dr. K. K. Dwines Director, ITTE Director rats Institute of Technology (Excellence) Around Nagar, Bhopal









Policy for Audit on Environment and Energy Initiatives

INTRODUCTION:

Being a leader in the Technical Educational Institution in the state, the institute is committed to develop and implement Green and Sustainable energy-system in the whole campus, which will as a consequence spreadtheawareness and motivation in the seciety to move toward clean and sustainable energy resources.

SCOPE:

Einspolicyapplicstoall stakeholders, students, staff and visitors

COMMITTEE FOR AUDIT:

- · It comprises of senior faculty (preferably Professor) as nominated by Director.
- Three senior faculty members (preferably Professor) as nominated by Director.
- Administrative staff

RESPONSIBILITIES:

- Audit committee or team will be responsible fordeveloping and implementing the audit plan, analyze data, and prepare reports.
- Institute' administrative staff will provide necessary resources and support for conducting
 the audits
- Faculty and staff will be responsible for implementing and maintaining environmental and energy initiatives.
- They will also cooperate with the audit process and implement recommended actions.
- Students will participate in awareness campaigns and promote environmentally responsible practices.

AUDIT FREQUENCY AND TYPES:

- · Audits will be conducted biannually.
- · It will include Green /Environment audit, Energy audit etc.

POLICY

The institute confirms its commitment to environment and energy initiatives through the

following p

TIT(E) BHOPAL TIT(E) BHOPAL Director
rechnocrats Institute of Technolog.
(Excellence)
Anand Nagar, Bhopal







- 6) Green audit / Environment audit
- 21 beergy audit
- 33 (Jean and green campus initiatives
- 4) Beyond the campus environmental promotion activities

AUDII DOCUMENTATION:

Audit committee

- Define outline requirements for documenting audit findings, conclusions, and recommendations.
- Define procedures for communicating audit results to relevant stakeholders, such as lostitute' administration, faculty, and staff.
- Establish mechanisms for monitoring and tracking implementation of audit recommendations.

REVIEW

This policy will be reviewed and updated periodically if necessary to reflect changes in environmental regulations, best práctices, and the Institute's evolving sustainability goals.

CONCLUSIONS:

By developing a comprehensive policy that addresses these aspects, the Institute effectively strives to continuously improve its environmental performance and contribute to a more sustainable future.

Dr. K. K. Dwivedi
Discero Ti:

[echnocrats Institute of Technora;
(Excellence)
Annual Nagar, Bhopal

Discussed & finalized in meeting of Academic Council (TTFE/2021/ACM/25) and submitted for information and approval in Board of Governance meeting.





Ms. Sadlina Karsoliya Chairperson, TITE

Director
Fechnocrate Institute of Technology
(Excellence)
Anand Nagar, Bhooal







POLICY ON ENERGY AND WATER CONSERVATION

TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)

(Run by Chandravadan) Mahlio Shiksha Samili, Bhapai)
Abarravao By AlCE New Deehi & Chry. of Manthyo Francist
Allino nor to exper Committee of the 2014 Annual of the

Ref: 111-E/Dir/2021/68

Date: 09/07/21

Office Order

lindingly is committed for energy conservation and fostering a culture of environmental responsibility among fieldly, staff, and students. As decided in Board of Governance meeting (TTT-22021/BOU/25), institute announces the policy for ensuring energy conservation within the comput with following objectives.

Objectives

- · Reduce overall energy consumption within the college
- · Promote the use of energy-efficient technologies and practices.
- · Raise awareness about energy conservation through education and outreach programs
- Continuously monitor and improve energy efficiency across the college.

the aim of this policy is to encounge and adept practices that would lead to sustainable description, raintimize curbon foot prints and depletion of natural resources and maximize exceeding of resources. This policy is in operation with immediate effect.



Dr. K. K. Dwiveda Director, TITE

Director
Fechnocrats Institute of Technology
(Excellence)
Annud Nagar, Bhopal

Encl Policy in detail

ony to:

- I mainly Champerson for kind information
- Very Principal Desca/QAC Coordinator
- 1 All RODs All Concern Faculty members
- 4. Registrar/Librarian
- S. Norice Boards and Institute Website



Director
(echnocras Institute of Technology
(Excellence)
Anand Nacar, Rhonai







Policy for Energy & Water Conservation

T Introduction:

continued for promoting alternate sources of energy, using power efficient equipments for sustainable development and indepting environmentally responsible practices, includes to conserve water, efficiently manage the degradable & non-degradable wastes, making efforts precure accepts, making disabled friendly, harrier free environment etc. The institute is making constant offorts to conserve the natural resources and spread awareness about need to protect the construction amongst its students, staff, faculty and community.

1. Scope

This policy governs the framing of rules and regulations with respect to using renewable sources of energy & initiatives and practices.

1. Policy:

The institute shall

- Take initiatives to make the compus green and clean and conserve energy and water, as also manage waste judiciously.
- Y Take initiatives for managing the degradable & non-degradable wastes, making offerss lso disabled friendly & barrier free environment for disabled.

4. Kes Strategies

- . Lighting:
 - Encourage switching off lights in unoccupied rooms.
 - Replace traditional incandescent bulbs with LED lighting.
 - Maximize natural light usage by opening blinds (if applicable) and strategically placing furniture.

· Equipment:

- Promute the use of energy-officient appliances and electronics.
- Implement power management settings on computers and other devices
- Regularly maintain equipment to ensure optimal performance.
- · Heating, Ventilation, and Air Conditioning (HVAC):
 - Encourage adjusting thermostats to maintain comfortable yet efficient temperatures.
 - Utilize natural ventilation whenever possible.
 - ✓ Schedule regular maintenance for HVAC systems.

· Renewable Energy:

Explore options for installing solar panels or other suitable renewable energy

TIT(E) BHOPAL

Director
Fechnocrats Institute of Technology
(Excellence)
Anand Nazar, Bhoral









- Integrate renewable energy education into curriculum where applicable
- An accuess and Education:
 - Organize workshops and seminars on energy conservation practices.
 - Develop and distribute informative materials on energy-saving type
 - Resugginge and celebrate achievements incenting conservation offorts
- · Wastewater Munutement:
 - Explore options for trenting and recycling wastewater for irrigation or another non-patable uses where applicable.
 - To sure proper disposal of wastewater to prevent contamination of water resources.

5 Implementation and Monitoring

- An Energy Munugement Committee will be established to oversee the implementation and effectiveness of this policy.
- . The committee will conduct regular energy audits to identify areas for improvement
- The college administration will allocate resources for implementing energy-saving interface.
- Progress towards energy conservation goals will be tracked and reported periodically.

6. Review and Revision

This policy will be reviewed and revised periodically if necessary to reflect hest practices and archipological advancements.

7. Cenclusion

This policy also provides a valuable learning environment for students to understand the amountaines of water conservation and become responsible water waters.

Dr. K. K. Dwivedi

Processor III

Fechaceus Institute of Technology
(Excellence)

Discussed & finalized in meeting of Academic Council (TITE/2021/ACM/21) and submitted for information and approval in Board of Governance meeting.

is the different in rooms of constitutions and

TIT(E)
BHOPAL

Ms. Sadims Karsoliya Chairpegagt, ITIB

Director
Technocrats Institute of Technology
(Excellence)







EXECUTIVE SUMMARY

The executive summary of the environment audit report presented in this section briefly outlines the identified water conservation measures and recommendations proposed during the project.

WATER CONSERVATION PROJECT TAKEN BY INSTITUTE

♣ Rainwater Harvesting System

The institute has successfully installed a "Rainwater Harvesting System" on the Technocrats Institute of Technology (Excellence), for blocks to maintain the groundwater level. This system saves about 80 to 85 % of the building's rooftop rainwater. It's appreciable.

♣ Sprinkler System

The institute has a "Water Sprinkler System" for the in the garden. It's appreciable.

★ Wastewater Treatment Plant

Technocrats Institute of Technology (Excellence), has an STP (Sewage Treatment Plant) under construction for wastewater generated from various activities on the campus. It's appreciable.

ENVIRONMENT AUDIT RECOMMENDATION

♣ Fresh Water Monitoring System

Installation of a "Cloud-based (IoT) Groundwater Extraction Monitoring System" for borewell to quantify freshwater consumption per day in the college OR Install water flow meters (Mechanical or Electronics) on the bore-well for quantify per day water consumption.

★ Sensor Based Water Taps

Installation of 'sensor-based water taps' reduces water wastage.

↓ Use Efficient Urinal Taps And Sensor Based Water Taps

Replacing these inefficient fixtures with Water Sense-labelled flushing urinals can save between 0.5 to 0.4 htres per flush without sacrificing performance. Installing water-saving without only reduce water use in facilities but also save on pumping energy

> Technocrats Institute of Technology (Excellence)

Anand Nagar, Bhonal





Installation of Water over Flow Sensor in Water Tanks

It was observed that water overflows from the overhead tanks. Therefore, it is recommended to install a water overflow sensor to prevent overflow from the tanks."

Awareness and Training program

Conduct awareness and training program, poster presentation to promote water conservation and sustainable development activities in the institute.








Chapter-1 INTRODUCTION

1.1 About Institute

Technocrats Institute of Technology (Excellence), Bhopal, is one of the premier institutes of Madhya Pradesh. This is an educational institute which is known in central India for imparting quality & value-based education for the past 12 years. This institute was started with a clear vision to develop the institute into a center of excellence in engineering education in the country with global standards. The institute is affiliated to Rajiv Gandhi Proudyogiki Vishwavidyalaya (RGPV), Bhopal for B.Tech, M.Tech, MCA programs & affiliated to Barkatullah University, Bhopal for MBA program. The institute is located in Anand Nagar, Raisen Road, Bhopal.

The institute offers six courses at undergraduate level leading to bachelor's degree, B.Tech. in Electronics & Communication Engineering, Computer Science & Engineering, Civil Engineering, Electrical Engineering, Mechanical Engineering and CSE (Artificial Intelligence & Machine Learning) disciplines. Apart from these courses, institute also offers admissions in master's degree, M.Tech. in Computer Science & Engineering, Construction Technology & Management and CSE (Artificial Intelligence & Machine Learning), Master of Computer Application (MCA) & Master of Business Administration (MBA). Presently the total intake is 600 in UG courses and 450 in PG courses.

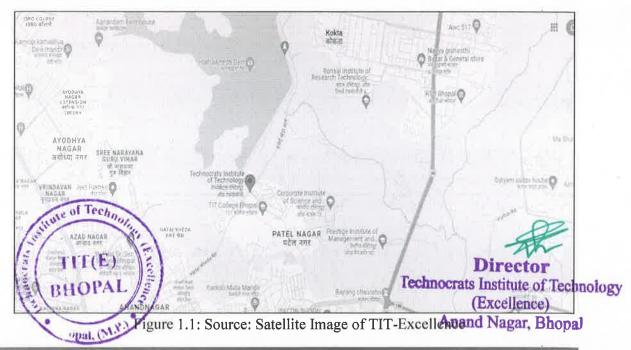





Vision of the Institute

To become a "Centre of Excellence" for quality education in the field of engineering, research and management so as to produce globally competent and socially responsible professionals, who can contribute in technological and socio-economic development of the nation as a whole and region in particular.

Mission of the Institute

M.1: To educate students with deep professional knowledge through innovative teaching-learning process and to make them aware of cutting edge technology so as to become capable of understanding and addressing the issues of society, state and the country.

M.2: To create in- house facilities for research and innovation to provide solution to the industrial problems.

M.3: To inculcate right human values and professional ethics, leadership qualities, communication and entrepreneurship skills in students to meet the need of society.

Institute Population


Sr. No.	Year	Teaching Staff (No.)	Non -Teaching Staff (No.)	Student (No.)
- 1	2020-21	212	98	2493
2	2021-22	212	98	2644
3	2022-23	213	98	2735









Institute Layout (Ground Floor Plan)

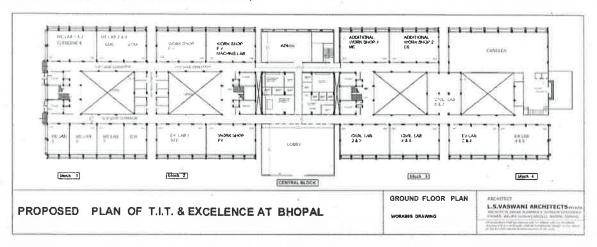

Institute Layout (First Floor Plan)

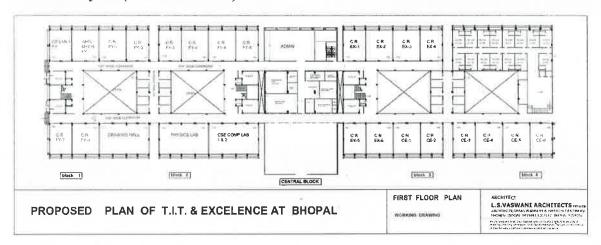

Institute Layout (Second Floor Plan)

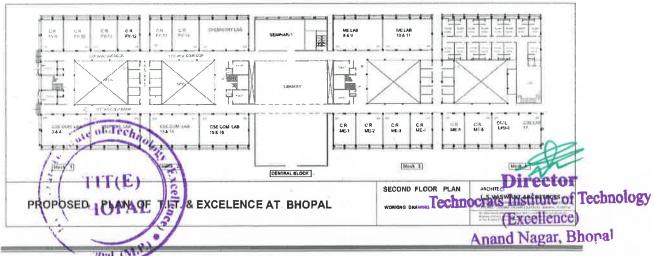


Environment Audit report prepared by EEPL, Indore, M.P.

Page 18






Institute Layout (Third Floor Plan)

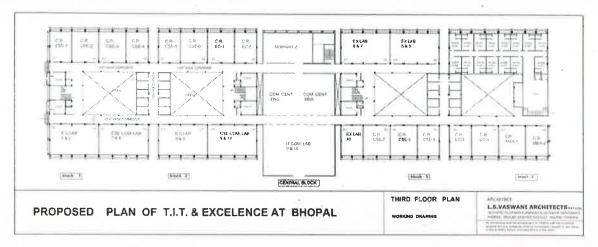

Institute Layout (Fourth Floor Plan)

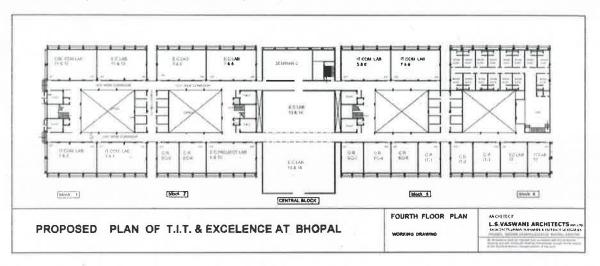







1.2 About Environment Audit

An environmental audit can be a highly valuable tool for education institutes and the universities in a wide range of ways to improve their energy, environmental, and economic performance while reducing waste and operating costs. Environmental audits provide a basis for calculating the economic benefits of water conservation projects by establishing the current rates of water use and their associated costs.

1.3 Objectives of Environment Audit

The general objective of environment audit is to prepare a baseline report on water conservation measures to mitigate consumption, improve quality and sustainable practices.

The specific objectives are

- ★ To monitor the water consumption and water conservation practices.
- To assess the quantity of water, usage, quantity of waste water generation and their reduction within the campus.

1.4 Target Areas of Environment Audit

This indicator addresses water sources, water consumption, irrigation, storm water, appliances and fixtures aquifer depletion and water contamination are taking place at unprecedented rates. It is therefore essential that any environmentally responsible institution should examine its water use practices.







B-block					
Sr. No.	Location	PM2.5	PM10	Particle	CO ₂
68	B04	16.2	36.2	3682	520
69	B 05	16.2	27.8	3497	553
70	B 06	16.9	21.6	5439	528
71	В 07	18.1	29.7	3794	547
72	B 08	17.7	22.4	3550	440
73	B 09	17.5	24.7	3650	451
74	B 10	16.6	23.8	3541	425
75	B 11	15	43.5	3556	472
76	B 12	16.5	23.8	6583	521
77	B 13	21.3	24.8	6593	516
78	B 14	27.3	26.3	6452	502
79	Civil Engg. Lab	20.8	27.7	8463	517
80	Engg. Geology lab	19.4	22.4	9562	531
81	B.M.E Lab	16.4	47.7	3432	435
82	Class Room	17.2	56.7	3320	481
83	Class Room	18.4	29.7	3116	471
84	Class Room	16.7	29.8	3216	502
85	Class Room	26.5	31.7	3265	517
86	Store Room	19.4	27.7	3265	531
87	Dept. of Civil Engg. Office	16.3	30.3	3802	435
88	Civil Library	18.6	28.4	3438	481
89	Class Room	17.3	26.3	3356	471
90	Class Room	17.8	29.3	3845	466
91	Class Room	19.3	21.3	3395	468
92	Wash Room	16.3	22.1	3865	454
93	Staff Wash Room	17.3	21.4	3320	475
94	CAD LAB	17.1	36.2	3116	482
95	Class Room	16.7	25.8	3216	520
96	Class Room	22.2	46.7	3265	323
97	Class Room	16.8	65.8	3265	520
98	Tutorial Room	17.4	45.9	3802	553
99	Class Room	18.2	64.7	3438	528
		16.6	76.3	3356	547
10	NCC Office NCC Office Noga Meditation	15.3	45.9	3845	440
=102	Dept. of Elec. & Electronic HOD	17.7	24.6	3Dfree	11
03	(E) Control System Lab	17.5		ocrats 865titu	

Anand Nagar, Bhopal



Technocrats Institute of Technology (Excellence), Bhopal (MP), Year 2021-23



Sr. No.	Location	PM2.5	PM10	Particle	CO ₂
104	Near Control System Lab	16.6	33.9	5389	472
105	Wash Room	15.2	28.7	5390	482
106	Wash Room (Male)	14.8	29.8	3794	520
107	Wash Room Boys	15.9	30.8	3550	323
108	Tutorial Room	16.7	32.1	3650	520
109	Tutorial Room	18.1	36.4	3541	553
110	PG Research Lab	18.4	57.9	3556	528
111	Software Engg	18.3	75.6	4179	547
112	Tutorial Room	18.6	45.6	4247	440
113	Class Room	19.4	35.7	3875	451
114	Computer Networking Lab	47.9	54.8	3354	425
115	T & P Cell	35.2	54.2	3267	472
116	T&P Hall	35.5	29.8	3658	440
117	Seminar Hall	43.6	30.8	3549	451
118	Wash Room Boys	19.3	32.1	3481	425
119	Wash Room Girls	16.3	36.4	3950	472
120	Wash Room Boys	17.3	38.1	4366	523
121	Class Room	17.1	34.1	4653	523
122	Class Room	16.7	35.7	4607	527
. 123	EDC Project Lab	17.7	53.5	3622	589
1/2/0	Tarantal Dague	162	517	2541	524

124	TUROFIEL INDOM	10.5	J+./	2271	257
127	Class Room	21.1	35.0	3035	521
128	T&P Hall	21.8	33.7	4057	431
129	Wash Room	31.6	35.9	7392	502
130	Wash Room	32.6	36.9	2745	517

C-block					
Sr. No.	Location	PM2.5	PM10	Particle	CO ₂
131	Conference Hall	19.8	42.7	3659	531
132	Conference Hall	17.7	47.9	3649	435
133	Guest Room	17.5	35.7	3794	481
134	Room	16.6	35.7	8563	471
135018 O	Room	15.2	35.7	3648	466
136	Seminar Hall T&P	14.8	5527	4859	468
£ /137 TIT	PPT Hall	15.9	32.1	Diffect	or 454
138	Boys Hostel	16.7	Technoc	rats Mathute	of Technol
39	GYM	22.5	32.7	(EA26llen	
10	/./	**	A	nand Nagar,	Bhonal
Shopal,	(M.P.)		A	nand Nagar,	Buob







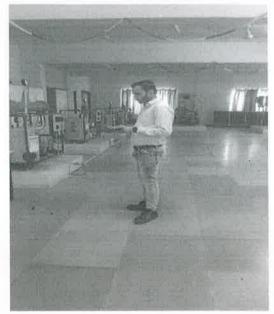


Fig.3.1: Indoor Air Quality Monitoring

Observation:-

- PM_{2.5} value is acceptable range. The 24-hour concentration of PM_{2.5} is considered unhealthy when it rises above 35.4μg/m³
- PM₁₀ value is an acceptable range. It should be below 155µg/m³
- CO₂ value is an acceptable range. It should be below 1000 ppm.







CHAPTER- 4 RAINWATER HARVESTING SYSTEM


4.1 Rainwater Harvesting systems

Rainwater harvesting is a technique to capture the rainwater when it precipitates, store that water for direct use or charge the groundwater and use it later.

There are typically four components in a rainwater harvesting system:

- Roof Catchment.
- Collection.
- ★ Transport.
- ♣ Infiltration or storage tank and use.

If rainwater is not harvested and channelized it runoffs quickly and flows out through stormwater drains. For storm-water management, the recharge pits, percolation pits, and porous trenches are constructed to allow storm water to infiltrate inside the soil.

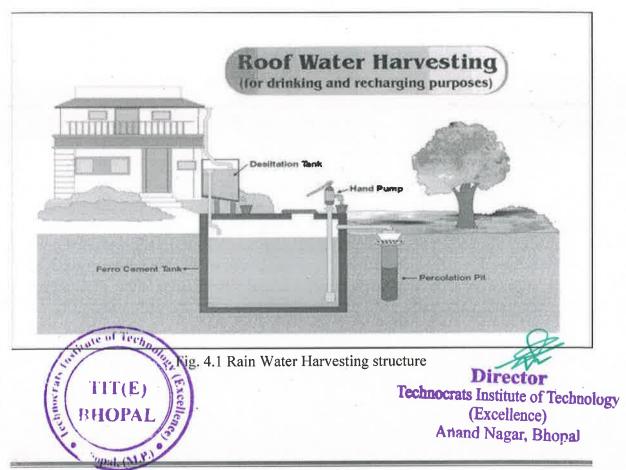





4.2 Rainwater Harvesting System in Institute

In institute (Excellence building) rain water harvesting is installed. It's appreciable

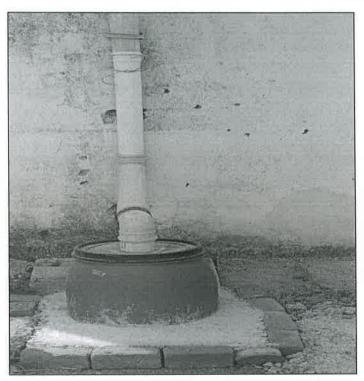


Figure: - 4.1 Rainwater harvesting in institute







END OF THE REPORT THANKS







GREEN AUDIT REPORT



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)

Anand Nagar, Opp. Hataikheda Dam, BHEL, Bhopal, Madhya Pradesh - 462021

PREPARED BY

EMPIRICAL EXERGY PRIVATE LIMITED

No. 201, OM Apartment, 214 Indrapuri Colony, Bhawarkuan, Indore 452 001 (M. P.), India 0731-4948831, 7869327256

Email ID:eempirical18@gmail.com

www.eeplgroups.com (2021-23)

Technocrats Institute of Technology
(Excellence)
Anand Nagar, Bhopal

TIT(E)

BHOPAL





CONTENTS

Sr. No. Items		Page No
I	Acknowledgement	3
II	Certification of Accreditation	4
III	Green Monitoring Committee	5
IV	Green Audit Team	7
V	Energy and Environment Policy	8
VI	Policy on Energy and Water Conservation	11
VII	Executive Summary	14
Chapter-1	Introduction	15
1.1	About Institute	15
1.2	About Green Auditing	19
1.3	Objectives of Green Auditing	19
Chapter- 2	Green Campus and Sustainable Development	20
2.1	Green Audit	20
2.2	List of Plant	21
Chapter- 3	Carbon Foot Print Assessment	22
3.1	About Carbon Foot Print	22
3.2	Methodology and Scope	23
3.3	Carbon Emission from Electricity	23
3.4	Carbon Emission from Vehicle	24
3.5	Carbon emission from DG set	25
3.6	Biomass Calculation and CO ₂ Sequestration of the Trees	26
3.7	Other Emission Excluded	29
Chapter-4	Waste Management	3.0
4.1	About Waste	30
4.2	Waste Management Practice Adopted by Institute	31
4.3	Waste Collection Point	32
4.4	Vermi-compost Pit	32
4.5	Organic Waste Composter M/c	33
Chapter-5	QR CODE SYSTEM	34
5.1	QR code system	34







ACKNOWLEDGEMENT

We would like to thank the Technocrats Institute of Technology (Excellence), Bhopal (M.P.). Our appreciation and gratitude to the management for granting us permission to conduct green audit for the institute

We are genuinely touched by the helpful attitudes and cooperation displayed by all the faculty members and technical staff involved in the audit. Their valuable assistance and cooperation significantly contributed to the successful execution of the audit.

For-Empirical Exergy Private Limited



Rajesh Kumar Singadiya

(Director)

M.Tech (Energy Management),

Accredited Energy Auditor [AEA-0284] Certified Energy Auditor [CEA-7271]

(BEE, Mmustry of Power, Govt. of India)

Empanelled Livery Auditor with MPUVN, Bhopal M.P.

Lead Auditor IS \$50001:2011 [EnMS) from FICCI, Delhi

Certified Water Andior (NPC, Govt. of India)

Chartered Engineer M-1699118], The Institution of Engineers (India)

Member of ISHRAE 58150]

Donal (M.S.

(Excellence)

Anand Nagar, Bhopal





CERTIFICATE OF ACCREDITATION



BUREAU OF ENERGY EFFICIENCY

Examination Registration No. EA- 7271

Accreditation Registration No. AEA-284



Certificate of Accreditation

The certificate is subject to the provisions of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

This certificate shall be valid until it is cancelled under regulation 9 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

On cancellation, the certificate of accreditation shall be surrendered to the Bureau within fifteen days from the date of receipt of order of cancellation.

Your name has been entered at AEA No....284.... in the register of list of accredited energy auditors. Your name shall be liable to be struck out on the grounds specified in regulation 8 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

Given under the seal of the Bureau of Energy Efficiency, Ministry of Power, this 5th day of October, 2018

Secretary,

Bureau of Energy Efficiency

New Delhi

TIT(E)
BHOPAL

Technocrats Institute of Technology
(Excellence)

Anand Nagar, Bhopal





GREEN MONITORING COMMITTEE



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



(Bun by Chandravaduni Mahltu Shikahu Sumiti, Bhopul) For Tour District Properties of the Properties o

TITE/Dis/2021/059

25.64.2021

Circular

We are pleased to announce the formation of a new committee dedicated to udvancing our campus's sustainability efforts. The "Clean & Green Campus Initiatives Committee" that will focus on waste management and energy conservation strategies nimed at reducing our environmental fnotprint

Committee Goals:

- Waste Management: Implementing effective recycling programs, reducing single-use plastics, and promoting sustainable practices across campus.
 Energy Management: Identifying opportunities for energy efficiency, promoting renewable energy sources, and raising awareness about energy conservation.
- Rain Water Harvesting: Help reducing flooding, recharging groundwater resources. Provide a sustainable and environmentally friendly way to conserve water.
- 4. Green Campus Management: Implementing environmental friendly practices and education combine to promote sustainable and eco-friendly practices in the campus.

Members of the Committee:

	Name of Member	Designation
S.N.	Name of Memoer	Chairman
1	Dr. Ravindra Gautam, Professor & Head, Civil Engineering	member
2	Dr. Ravindra Gautain, Floressor & Head, Mechanical Engineering Dr. Adarsh Sachdeva, Professor & Head, Mechanical Engineering	member
3	Dr. Adarsh Sachueva, Professor & Head, Electrical Engineering Prof. Rahul Arora, Assit Professor, Civil Engineering Prof. Apil Solanki, Assistant Professor, Civil Engineering	member
24.5	Prof. Anil Solanki, Assistant Fitteeson	

Objectives:

- Conducting regular audits to assess current waste and energy usage.
- Developing and implementing action plans to achieve waste reduction and energy
- Collaborating with faculty, staff, and students to foster a culture of sustainability on campus.
- Organizing educational campaigns and events to raise awareness about environmental issues.



Director matitude of Technology d Nagar, Hhopal









TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



(Bun by Chandlevadon) Mahita Shiksha Samiti, Bhapal) Afficient To Rolling, Constitutional Proochyogis, Villaworksyckoyo, Brospo of reason 1810, \$100,000 33, Fr. No. 0715-3731801 Fox. 0715-37318177 website: www.

T11 F/D16/2022/064

10.07.2022

Circular

With inference to the circular TTTE/Dir/2021/059, dt. 25.04.2021, we are refraining the "Clean & Green Campus loinatives Committee" as follows.

Members of the Committee:

	2) differential	Designation
8.N.	Name of Member	Chairman
1	Dr. Ravindra Gautam, Professor & Head, Civil Engineering	member
-	De Manish Joshi Professor & Head, Mechanical Engineering	
6-	Prof. Rajesh Sahu, Assit Professor, Electrical Engineering	member
. 3	Prof. Rajesh Sann, Assat Charles Civil Engineering	member
- 4	Prof. Pankaj Dixit, Assistant Professor, Civil Engineering	

Goals & objectives of the committee shall remain as follows.

Committee Goals:

- 1. Waste Management: Implementing effective recycling programs, reducing single-use plastics, and promoting sustainable practices across campus.

 2. Energy Management: Identifying opportunities for energy efficiency, promoting renewable
- energy sources, and raising awareness about energy conservation.
- 3. Rain Water Harvesting: Help reducing flooding, recharging groundwater resources. Provide a sustainable and environmentally friendly way to conserve water.
- 4. Green Campus Management: Implementing environmental friendly practices and education combine to promote sustainable and eco-friendly practices in the campus.

Objectivest

- Conducting regular audits to assess current waste and energy usage.
- Developing and implementing action plans to achieve waste reduction and energy
- Collaborating with faculty, staff, and students to foster a culture of sustainability on campus. Organizing educational campaigns and events to raise awareness about environmental issues.

FIT Excellence Director business of Technology (Excellence) knowd Nagar, Bhopal







GREEN AUDIT TEAM

The audit team constituted by the following senior technical executives from the Empirical Exergy Private Limited,

- ♣ Mr. Rajesh Kumar Singadiya[Director & Accredited Energy Auditor AEA-0284]
- Ms. Laxmi Raikwar [Energy Expert and Report Reviewer]
- ♣ Mr. Ajay Nahra [Sr.Project Engineer]
- ₩ Mr. Charchit Pathak [Sr.Project Engineer]
- ₩ Mr. Mohan Choudhary [Electrical Engineer]
- Mr. Praveen Punasiya [Field Engineer]







ENERGY ENVIRONMENT POLICY



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



(Run by Chandravadani Mahila Shiksha Samiti, Bhopat) Approved by AICTE New Delite & Govt of Macingo Fractic Athronod to Rajoev Candhi Proudyogiki Vishwatvidyalaya: Bhogasi Post Piptoni 8HEL Bhogai-71, Ph. No.-0755-2751601 (as-0755-2751679 webstormow literacetoez-

Ref: TTT-E/Dir/2021/69

Date: 10/07/21

Office Order

histilitie is committed for promoting environmental sustainability and reducing its conventional onergy consumption. As decided in Board of Governance meeting (THTE/2021/BOG/25), institute automaces the policy for ensuring accountability, compliance with regulations, and continuous ingrovement in sustainability offerts with following objectives.

Objectives

- Evaluate the institute's progress in achieving its environmental and energy goals
- Identify areas for improvement in resource utilization (energy, water, waste)
- Ensure compliance with relevant environmental regulations.
- Promote environmental awareness and responsibility among the institute community
- Identify opportunities for cost-saving through improved resource management
- Identifying opportunities for improvement, and promoting sustainable practices.

This policy establishes a framework for conducting regular audits to assess and improve the effectiveness of our environment and energy initiatives. This policy is in operation with immediate effect.



Fact Policy in detail Copy to:

- Hamble Chairperson for kind information
- All HODs/All Concern Faculty
- Registrac'l iberriun
- Worker Brands and Institute Website



TIT(E)

BHOPAL

Dr. K. K. Dwivedi Director, ITUE Director (Excellence) Amand Nagar, Bhopal

Director Technocrats Institute of Technology (Excellence) Annad Nagar, Bhopal







Policy for Audit on Environment and Energy Initiatives

INTRODUCTION:

Hong a leader in the Fechnical Educational Institution in the state, the institute is committed to develop and implement Green and Sustainable energy-system in the whole campus, which will as a consequence spreadtheawareness and motivation in the society to move toward clean and stratainable energy resources.

SCOPE:

thispelicyappliestoall stakeholders, students, staff and visitors

COMMITTEE FOR AUDIT:

- It comprises of senior faculty (preferably Professor) as nominated by Director.
- . Three senior faculty members (preferably Professor) as nominated by Director.
- · Administrative staff

RESPONSIBILITIES:

- Audit committee or team will be responsible fordeveloping and implementing the audit plan, analyze data, and prepare reports.
- Institute' administrative staff will provide necessary resources and support for conducting the audits.
- Faculty and staff will be responsible for implementing and maintaining environmental and energy initiatives.
- They will also cooperate with the audit process and implement recommended actions.
- Students will participate in awareness campaigns and promote environmentally responsible practices.

AUDIT FREQUENCY AND TYPES:

- · Audits will be conducted biannually.
- Is will include Green/Environment audit, Energy audit etc.

POLICY

The institute confirms its commitment to environment and energy initiatives through the

following p

TIT(E) BHOPAL TIT(E) BHOPAL Director
cechnocrats Institute of Technolog,
(Excellence)
Anand Nagar, Bhopal







- 1) Green hadit / Environment audit
- 2) Inergy audit
- i) Clean and green compus initiatives
- 4) Reyond the campus environmental promotion activities

AUDIT DOCUMENTATION:

Audit committee

- Define autline requirements for documenting audit findings, conclusions, and recommendations.
- Define procedures for communicating audit results to relevant stakeholders, such as lastitute' administration, faculty, and staff.
- Establish mechanisms for monitoring and tracking implementation of audit recommendations.

REVIEW

This policy will be reviewed and updated periodically if necessary to reflect changes in environmental regulations, best practices, and the Institute's evolving sustainability goals.

CONCLUSIONS:

By developing a comprehensive policy that addresses these aspects, the Institute effectively strives to continuously improve its environmental performance and contribute to a more sustainable future.

Dr. K. K. Dwivedi
Directo FTE
fechnocrats Institute of Technorus
(Excellence)
Annual Nagar Phonoi

Discussed & finalized in meeting of Academic Council (TTFE/2021/ACM/25) and submitted for information and approval in Board of Governance meeting.





Ms. Sadlina Karsoliya Chairperson, TITE

Director
iochnocrata leastitute of Technology
(Excellence)
Anand Nagar, Bhoral







POLICY ON ENERGY AND WATER CONSERVATION



Approved by ALCTE New Dath & Gov. of Attacky Strack

Fam Hiplins Mile Books of the No. 18 22 110 Par 4755 28 1628 which was Horestone or eat

Ref: 11T-F/Dir/2021/68

Date: 09/07/21

Office Order

Institute is committed for energy conservation and fostering a culture of environmental responsibility among fisculty, staff, and students. As decided in Board of Governance meeting (ITTE/2021/BOCC25), institute announces the policy for ensuring energy conservation within the cumpus with following objectives.

Objectives

- · Reduce overall energy consumption within the college.
- · Promote the use of energy-efficient technologies and practices:
- Raise awareness about energy conservation through adacation and outrouch programs.
- · Continuously monitor and improve energy efficiency across the college.

The am of this policy is to encourage and adopt practices that would lead to sustainable development, minimize carbon foot prints and depletion of natural resources and maximize recycling of resources. This policy is in operation with immediate effect.



Loci Policy in detail

Copy to:

- 1 Emile Champenan for kind information
- Vall Principal/Denos/QAC Coordinator
- 2 All BODs: All Concern Facility members
- 1 Registrate theation
- 5. Notice Brands and Institute Website



Director, TITE

Director
fechnoceus Institute of Technology
(Bacellence)

Anand Nagar, Bhopul

Dr. K. K. Dwivedi

Director fechnocran Institute of Technology (Excellence) Anand Nanar, Bhorsal







Policy for Energy & Water Conservation

(Introduction:

rechnorous insulate of Technology (Excellence), Bhopal, Medicya Pradesh is fully committed for promoting alternate sources of energy, using power efficient equipments for sustainable development and adopting environmentally responsible practices, methods to conserve water, efficiently manage the degradable & non-degradable wastes, making efforts given campus, moking disabled friendly, harrier free environment etc. The institute is making constant efforts to conserve the natural resources and spread awareness about deed to protect the environment amongst its students, staff, faculty and community.

2. Scope:

This policy governs the framing of rules and regulations with respect to using renewable sources of criergy & initiatives and practices.

3. Policy

He institute shall

- Take initiatives to make the compus green and clean and conserve energy and water, as also manage waste judiciously.
- Take initiatives for managing the degradable & non degradable wastes, making offers
 for disabled friendly & barrier free environment for disabled.

4 Ko Strategies

- . Lighting:
 - Encourage switching off lights in unoccupied rooms.
 - Replace traditional incandescent bulbs with LED lighting.
 - Maximize natural light usage by opening blinds (if applicable) and strategically placing furniture.

Equipment:

- Promote the use of energy-efficient appliances and electronics.
- Implement power management settings on computers and other devices.
- Regularly maintain equipment to ensure optimal performance.

· Heating, Ventilation, and Air Conditioning (HVAC):

- √ Encourage adjusting thermostats to multitain conifortable yet efficient temperatures.
- √ Utilize natural ventilation whenever possible.
- ✓ Schedule regular maintenance for HVAC systems.

· Renewable Energy:

Explore options for installing solar panels or other suitable renewable end



Director

[echnocrus Institute of Technology
(Excellence)

Anuad Nagar, Bhoral





The





Integrate cenewable energy education into curriculum where applicable

Awareness and Education:

- Organize workshops and seminars on energy conservation practices
- Uccelep and distribute informative materials on energy-saving tips
- Recognize and calebrate achievements in energy conservation efforts.

Wastewater Management:

- Explore options for treating and recycling wastewater for irrigation or another non-potable uses where applicable.
- Ensure proper disposal of wastewater to prevent contamination of water resources.

5 Implementation and Monitoring

- An Energy Management Committee will be established to oversee the implementation and effectiveness of this policy.
- The committee will conduct regular energy audits to identify areas for improvement
- The college administration will allocate resources for implementing energy-saving investion.
- Progress towards energy conservation gosts will be tracked and reported periodically.

6. Review and Revision

This policy will be reviewed and revised periodically if necessary to reflect best practices and actionlogical advancements

?. Canclusion

This policy also provides a valuable learning environment for students to understand the importance of water conservation and become responsible water users.

Dr. K. K. Dwivedi

Director I To Inchrocate Institute of Technolog-(Excellence)

Discussed & finalized in meeting of Academic Council (ffTE/2021/ACM/21) and submitted for information and approval in Board of Governance meeting.





- Ms. Sadina Karioliya Chairperson, TITE Director

Director
Technocrats Institute of Technology
(Excellence)
Anned Manage Blanket







EXECUTIVE SUMMARY

The executive summary of the green audit report presented in this section briefly outlines the statistics of plants, trees in the campus, and carbon foot print status of the college.

GREEN INITIATIVES TAKEN BY COLLEGE.

Campaign of Plantation And Green Campus

The college has around 8036 trees on campus. It is a good initiative taken by the management for creating a green campus under the plantation campaign. This effort is commendable.

★ E-vehicle System

The management has use E- vehicle in the campus for internal movement of staff and students. It's save nature resource as well as improved air quality of the campus. It is appreciable.

♣ Solar System

The institute has 5 KWp solar energy off grid roof top system. It is appreciable.

GREEN AUDIT RECOMMENDATION

→ QR Code System on Tree

While the world seems to be going digital, people lack the time to read books and process the information they contain. Therefore, the college can provide QR codes on the trees to share information and leverage this rapidly growing platform for a unique purpose.

♣ Installation Organic Waste Composting Machine

There is good potential for installation of organic waste composting machine to treat organic waste generated from trees and lawn area of the college campus. The output of above organic waste composting machine is good manure for garden and plants in the campus.

Five Dust bin System

opal, (M.Y.

is observed that the college has adopted a two dustbin system for all kinds of waste generated of campus. It is recommended to implement a five-dustbin system for the segregation of different types of waste.

Technocrats Institute of Technology (Excellence)

Anand Nagar, Bhopal





Chapter-1 INTRODUCTION

1.1 About Institute

Technocrats Institute of Technology (Excellence), Bhopal, is one of the premier institutes of Madhya Pradesh. This is an educational institute which is known in central India for imparting quality & value-based education for the past 12 years. This institute was started with a clear vision to develop the institute into a center of excellence in engineering education in the country with global standards. The institute is affiliated to Rajiv Gandhi Proudyogiki Vishwavidyalaya (RGPV), Bhopal for B.Tech, M.Tech, MCA programs & affiliated to Barkatullah University, Bhopal for MBA program. The institute is located in Anand Nagar, Raisen Road, Bhopal.

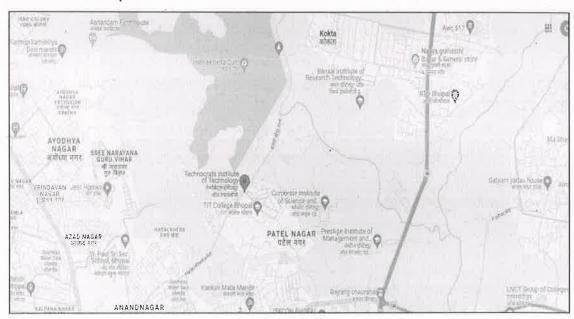


Figure 1.1: Source: Satellite Image of institute

The institute offers six courses at undergraduate level leading to bachelor's degree, B.Tech. in Electronics & Communication Engineering, Computer Science & Engineering, Civil Engineering, Electrical Engineering, Mechanical Engineering and CSE (Artificial Intelligence, & Machine Learning) disciplines. Apart from these courses, institute also offers admissions in master's degree, M.Tech. in Computer Science & Engineering, Construction Technology & Management and CSE (Artificial Intelligence & Machine Learning). Master of Unifolder Application (MCA) & Master of Business Administration (MBM) Presently the total intake is 600 in UG courses and 450 in PG courses.





Vision of the Institute

To become a "Centre of Excellence" for quality education in the field of engineering, research and management so as to produce globally competent and socially responsible professionals, who can contribute in technological and socio-economic development of the nation as a whole and region in particular.

Mission of the Institute

M.1: To educate students with deep professional knowledge through innovative teaching-learning process and to make them aware of cutting edge technology so as to become capable of understanding and addressing the issues of society, state and the country.

M.2: To create in-house facilities for research and innovation to provide solution to the industrial problems.

M.3: To inculcate right human values and professional ethics, leadership qualities, communication and entrepreneurship skills in students to meet the need of society.

Institute Population


Sr. No.	Year	Teaching Staff (No.)	Non -Teaching Staff (No.)	Student (No.)
1	2020-21	212	98	2493
2	2021-22	212	98	2644
3	2022-23	213	98	2735









Institute Layout (Ground Floor Plan)

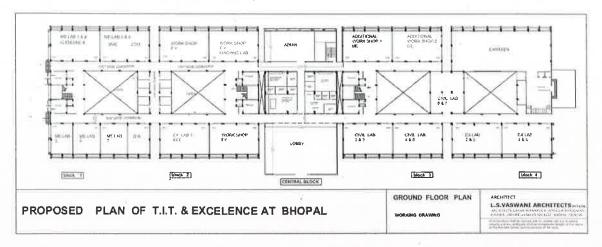

Institute Layout (First Floor Plan)

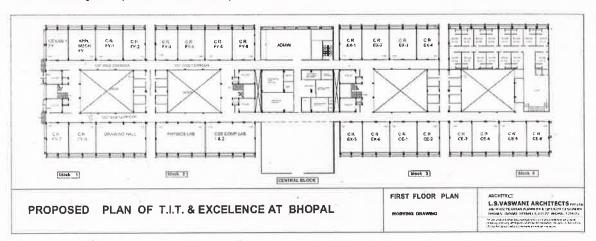


Institute Layout (Second Floor Plan)

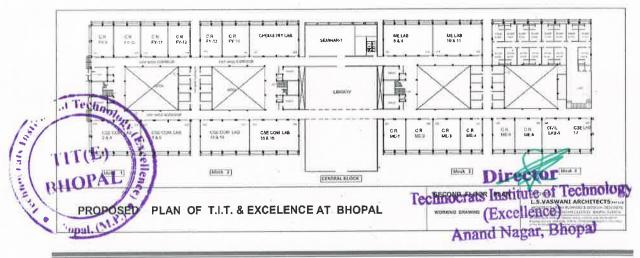






Institute Layout (Third Floor Plan)

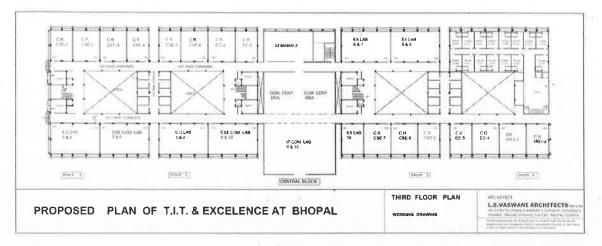

Institute Layout (Fourth Floor Plan)

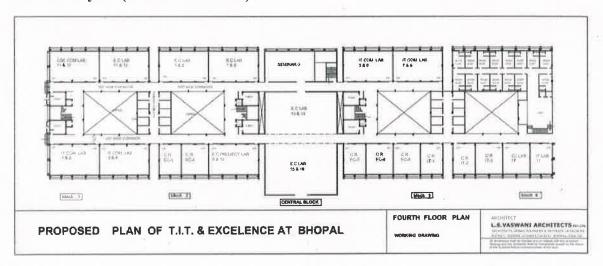







1.2 About Green Audit

Eco campus is concepts implemented in many educational institutions, all over the world to make them sustainable because of their mass resource utilization and waste discharge in to the environment.

Green audit means to identify opportunities to sustainable development practices, enhance environmental quality, improve health, hygiene and safety, reduce liabilities achieve values of virtue. Green audit also provides a basis for calculating the economic benefits of resource conservation projects by establishing the current rates of resource use and their associated costs.

Green auditing of "Technocrats Institute of Technology (Excellence), Bhopal (M.P.)" enables to assess the life style, action and its impact on the environment. This green audit was mainly focused on greening indicators like utilisation of green energy (solar energy) and optimum use of secondary energy sources (petrol and diesel) in the Institute campus, vegetation, and carbon foot print of the campus etc. The aim of green auditing is to help the institution to apply sustainable development practices and to set examples before the community and young learners.

1.3 Objectives of Green Audit

The general objective of green audit is to prepare a baseline report on "Green campus" and alternative energy sources (solar energy), measures to mitigate resource wastage and improve sustainable practices.

The specific objectives are:

- To inculcate values of sustainable development practices through green audit mechanism.
- ♣ Providing a database for corrective actions and future plans.
- ♣ To identify the gap areas and suggest recommendations to improve the green campus status of the institutes.








CHAPTER- 2 GREEN CAMPUS AND SUSTAINABLE DEVELOPMENT

2.1 Green Audit

In the survey, the focus has been given to the assessment of the present status of plants and trees on the institute and efforts made by the management authorities for nature conservation. The campus is in the vicinity of approximately more than 8036 trees.

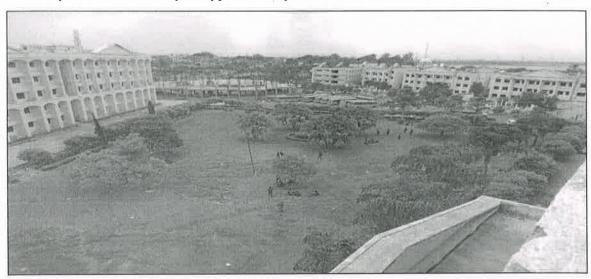









2.2 List of plants in Institute campus

Sr. no	Tree Name	Quantity (No's)
1	Areria	1000
2	Arekapama	800
3	Kanisa palam	200
4	Rechpama	300
5	Kundi pama	300
6	Caryota	200
7	Kutranjiva	30
8	Bgadi	2000
9	Varykate jasmine	2000
10	Gulab	100
11	Ficus	100
12	Fastalpama	6
13	Dracaena fragrans	500
14	Maritina	500
of Tec	Total	8036

Institute has 8036 trees in the campus. This is good initiative taken by management for green campus under the campaign of plantation. It's appreciable. Technocrats Institute of Technology (Excellence)

Anand Nagar, Bhopal



Technocrats Institute of Technology (Excellence), Bhopal (MP), Year 2021-23



CHAPTER-3 CARBON FOOT PRINT ASSESSMENT

3.1 About Carbon Foot Print.

Climate change is one of the greatest challenges facing nations, governments, institutions, business and mankind today.

Carbon footprint is a measure of the impact your activities have on the amount of carbon dioxide (CO₂) produced through the burning of fossil fuels and is expressed as a weight of CO₂ emissions produced in tones.


We focus on consumption in each of our five major categories: housing, travel, food, products and services. In addition to these we also estimate the share of national emissions over which we have little control, government purchases and capital investment.

For simplicity and clarity all our calculations follow one basic method. We multiply a use input by an emissions factor to calculate each footprint. All use inputs are per individual and include things like fuel use, distance, calorie consumption and expenditure. Working out your

inputs is a matter of estimating them from your home, travel, diet and spending behaviour.

Although working out our inputs can take some investigation on your part the much more challenging aspect of carbon calculations is estimating the appropriate emissions factor to use in your calculation. Where possible you want this emissions factor to account for as much of the relevant life cycle as possible.

We all have a carbon footprint...

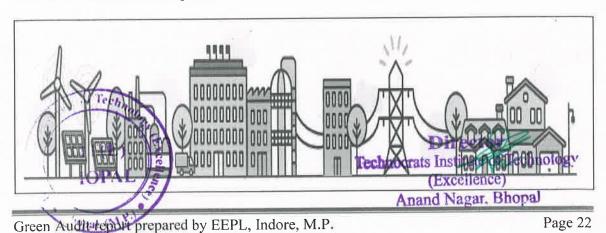





3.2 Methodology and Scope

The carbon footprint gives a general overview of the College greenhouse gas emissions, converted into CO₂ -equivalents and it is based on reported data from internal and external systems. The purposes of the carbon indicators are to measure the carbon intensity per unit of product, in addition to showing environmental transparency towards external stakeholders. The carbon footprint reporting approach undertaken in this study follows the guidelines and principles set out in the "Greenhouse Gas Protocol Corporate Accounting and Reporting Standard" (hereafter referred to as the GHG Protocol) developed by the Greenhouse Gas Protocol Initiative and international standard for the quantification and reporting of greenhouse gas emissions -ISO 14064. This is the most widely used and accepted methodology for conducting corporate carbon footprints. The study has assessed carbon emissions from the College Campus. This involves accounting for, and reporting on, the GHG emissions from all those activities for which the company is directly responsible. The items quantified in this study are as classified under the ISO 14064 standards: The report calculates the greenhouse gas emissions from the College. This includes electricity, as well as emission associated with diesel consumption in the College vehicle. The emission associated with air travel, waste generation, administration, and marketing related activities has been excluded from the current study. Emissions from business activities are generally classified as scope 1, 2 or 3 areas classified under the ISO 14064 standards.

3.3 Carbon emission from electricity

Direct emissions factors are widely published and show the amount of emissions produced by power stations in order to produce an average kilowatt-hour within that grid region

Unlike with other energy sources the carbon intensity of electricity varies greatly depending on how it is produced and transmitted. For most of us, the electricity we use comes from the grid and is produced from a wide variety of sources. Although working out the carbon intensity of this mix is difficult, most of the work is generally done for us.

Electricity used on the site is the significant contributors towards GHGs emission from the unit. Electricity used on the is the most direct, and typically the most significant, a contributor to a units carbon footprint. Thus, using an average fuel mix of generating electricity carbon diexid intensity of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0.961 p. g. 100 kg which is the contributor of electricity for national grid is assumed to be 0





Table 3.1: Emission due to Electricity from Grid Unit


Sr.No.	Year	Total Unit Consumption	Unit	Emission Factor kg CO2e/kWh	Emission ton CO ₂ e/year
1	2021-22	3,90,751	kWh	0.9613	375.62
2	2022-23	4,99,663	kWh	0.9613	480.33

Table3.2: Emission due to Electricity from Solar Unit

Sr.No.	Year	Solar Unit	Unit	Emission Factor kg CO2e/kWh	Emission reduction Ton CO2e/ year
1	2021-22	7300	kWh	0.9613	7.01
2	2022-23	6388	kWh	0.9613	6.14

3.4 Carbon Emission from Vehicles

In India, it is the third most CO₂ emitting sector, and within the transport sector, road transport contributed more than 90% of total CO₂ emissions (IEA, 2020; Ministry of Environment Forest and Climate Change, 2018)

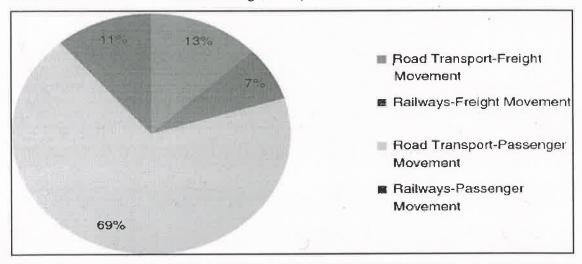

Transportation (29 percent of 2019 greenhouse gas emissions) – The transportation sector generates the largest share of greenhouse gas emissions. Greenhouse gas emissions from transportation primarily come from burning fossil fuels for our cars, trucks, ships, trains, and planes

We have also considered the total GHGs emission done by transportation facilities available on the campis like Cars, ambulances, Buses, etc. We consider the different types of vehicles which are bid a Part puto and diesel fuels.

(Excellence)





CO₂ Emission from vehicle

As per discussion by the concerned department in the institute and data provided by management. The following details are given in the table:

Table 3.3: Distance travelled and Diesel Consumption of Vehicle

Sr. No.	Year	Distance Travelled Per Month (K.M.)	Diesel Consumption (Lit.)
11	2021-22	2,62,500	57692
2	2022-23	2,84,375	62500

$$CO_2$$
 Per liter

Total CO_2 Emissions = X Distance (in km)

Average Mileage (Km/Liter)

- ❖ CO₂ Emissions from a Littre of Diesel: 2689.56 grams CO₂/ litre.
- \bullet CO₂ Emissions Year 2021-22= (2689.56/4.5) X 2, 62,500 = 155.15 ton/year
- \bullet CO₂ Emissions Year 2022-23= (2689.56/4.55) X 2, 84,375 = 168.10 ton/year

CO₂ Emission from LPG (gas cylinder)

- ❖ CO₂ Emissions from kg of LPG: 3.01 CO₂/ kg of LPG.
- ❖ LPG Cylinder Consumption Year 2021-22= 20 No *12 *19 Kg/ Cylinder = 4560Kg
- \bullet CO₂ Emissions Year 2021-22= 4560x 3.01 = 13.72 Ton/year
- ❖ LPG Cylinder Consumption Year 2021-22= 25 No *12 *19 Kg/ Cylinder =5700 Kg
- Arr CO₂ Emissions Year 2022-23= 5700x 3.01 = 17.15 Ton/year

3.5 Carbon emission from DG set

The institute has one DG set use for emergency power supply. Annual diesel consumption for year 2021-22 was 1270 and for the year 2022-23 was 830 lit.

- ❖ CO₂ Emissions from a Lit.of diesel: 2689.56 grams CO₂/ lit.
- Diesel consumption Year 2021-22 = 1270 Lit.

 Diesel consumption Year 2021-22 = 1270 x 2689 = 3.41 Ton /Year
- Diese consumption Year 2022-23 = 830 Lit.

Director

consumption Year 2022-23 = 830 x 2689 Technology (Excellence)

Anand Nagar, Bhopal





3.6 Biomass Calculation and CO₂ Sequestration of the Trees

1. Estimation of above-ground biomass (AGB)

$$K = 34.4703 - 8.0671D + 0.6589 D^2$$

Where = K is above-ground biomass.

D is Breast height diameter in (cm)

- 2. Estimation of below ground biomass (BGD) = AGB x 0.15
- 3. Total Biomass (TB) = AGB + BGB
- 4. Calculation of carbon dioxide Weight sequestered in the tree in Kg.

$$C = W \times 0.50$$

5. Calculation the weight of CO₂ sequestered in the tree per year in Kg.

$$CO_2 = C \times 3.666$$

Where: -

AGB = above ground biomass.

D = Diameter of tree breast height.

BGB = Below Ground Biomass.

C = Carbon

TB = Total Biomass.



Technocrats Institute of Feelmology
(Excellence)

Anand Nagar Phonal





Table: 3.4 CO₂ Sequestered Calculation of tree (Year 2021-22)

Sr. no.	Tree Name	Average Diameter CM (10 to 100)	AGB	BGB	Total	Carbon Storage	Amount of CO ₂ Sequestered	Total	Total Amount of CO ₂ Sequestered	Annually CO ₂ Sequestered amount (Ton/year)
1	Areria	52	1450.7	217.6	1668.3	834.2	3058.1	800	2446456	33.37
2	Arekapama	28	340.9	51.1	392.0	196.0	718.5	760	546059	7.45
3	Kanisa palam	60	1994.5	299.2	2293.7	1146.8	4204.3	200	840857	11.47
4	Rechpama	35 -	583.8	87.6	671.3	335.7	1230.6	300	369172	5.04
5	Kundi pama	62	2144.0	321.6	2465.6	1232.8	4519.5	300	1355838	18.49
6	Caryota	44	993.9	149.1	1143.0	571.5	2095.0	150	314255	4.29
7	Kutranjiva	40	798.0	119.7	917.7	458.9	1682.2	30	50466	0.69
8	Bgadi	80	3734.1	560.1	4294.2	2147.1	7871.2	2000	15742466	214.71
9	Varykate jasmine	38	708.3	106.2	814.5	407.2	1493.0	2000	2985935	40.72
10	Gulab	10	21.7	3.3	24.9	12.5	45.7	80	3658	0.05
11	Ficus	60	1994.5	299.2	2293.7	1146.8	4204.3	100	420429	5.73
12	Fastalpama	54	1578.5	236.8	1815.3	907.7	3327.5	6	19965	0.27
13	Dracaena fragrans	12	35.4	5.3	40.7	20.4	74.7	490	36593	0.50
14	Maritina	48	1211.4	181.7	1393.2	696.6	2553.7	500	1276827	17.41
		11.								360.19

Institute has 7716 trees on campus. This is a good initiative taken by management for a green campus under the campaign of the plantation.

It's appreciable. There are total CO₂ sequestered of 360.19 Tons /Year. It's appreciable.

Green Audit report prepared by EEPL, Indore, M.P.

Page 27







Table 3.5: CO₂ Sequestered Calculation of tree (Year 2022-23)

Sr. no.	Tree Name	Average Diameter CM (10 to 100)	AGB	BGB	Total	Carbon Storage	Amount of CO ₂ Sequestered	Total	Total Amount of CO ₂ Sequestered	Annually CO ₂ Sequestered amount (Ton/year)
1	Areria	52	1450.7	217.6	1668.3	834.2	3058.1	1000	3058070	41.71
2	Arekapama	28	340.9	51.1	392.0	196.0	718.5	800	574799	7.84
3	Kanisa palam	60	1994.5	299.2	2293.7	1146.8	4204.3	200	840857	11.47
4	Rechpama	35	583.8	87.6	671.3	335.7	1230.6	300	369172	5.04
5	Kundi pama	62	2144.0	321.6	2465.6	1232.8	4519.5	300	1355838	18.49
6	Carvota	44	993.9	149.1	1143.0	571.5	2095.0	200	419007	5.71
7	Kutranjiva	40	798.0	119.7	917.7	458.9	1682.2	30	50466	0.69
8	Bgadi	80	3734.1	560.1	4294.2	2147.1	7871.2	2000	15742466	214.71
9	Varykate jasmine	38	708,3	106,2	814.5	407.2	1493.0	2000	2985935	40.72
10	Gulab	10	21.7	3,3	24.9	12.5	45.7	100	4572	0.06
11	Ficus	60	1994.5	299.2	2293.7	1146.8	4204.3	100	420429	5.73
12	Fastalpama	54	1578.5	236.8	1815.3	907.7	3327.5	6	19965	0.27
13	Dracaena fragrans	12	35.4	5.3	40.7	20.4	74.7	500	37340	0.51
14	Maritina	48	1211.4	181.7	1393.2	696.6	2553.7	500	1276827	17.41
		Tot	al CO ₂ Emi	ssion neut	ralize by t	ne trees				370.37

Institute has 8036 trees on campus. This is a good initiative taken by management for a green campus under the campaign of the plantation.

It's appreciable. There are total CO₂ sequestered of 370.37 Tons /Year. It's appreciable.

Green Audit report prepared by EEPL, Indore, M.P.

Page 28







Table 3.6: Total CO₂ Emission by the Institute

Sr. No.	CO ₂ (Emission & Neutralized) Sources	CO ₂ Emission Ton/year (2021-22)	CO ₂ Emission Ton/year (2022-23)
1	Electricity	375.62	480.33
2	Vehicle	155.15	168.1
3	LPG Cylinder	13.72	17.15
4	DG set Diesel	3.41	2.23
5	Total CO ₂ Emission	547.9	667.81
6	CO ₂ Emission Neutralized by Tree	360.19	370.37
7	CO ₂ Emission Neutralized by Solar	7.01	6.14
8	Net CO ₂ Emission of the Institute	180.80	291.3

Observation:

♣ Net CO₂ Emission of the Institute is increase of the organization

3.7 Other Emissions Excluded

This study did not evaluate the carbon sequestration potential of existing from the staff commuting, food supply, official flights, paper products, water supply, and waste disposal and recycling due to limited data availability. The current study identifies areas where data monitoring, recording and archiving need to be developed for enlarging the scope of mapping of GHGs emission in the future years. Accordingly, a set of tools and record keeping procedure will be developed for improving the quality of data collection for the next year carbon foot print studies.







CHAPTER- 4 WASTE MANAGEMENT

4.1 About Waste

Human activities create waste, and it is the way these wastes are handled, stored, collected and disposed of, which can pose risks to the environment and to public health waste management is important for an eco-friendly campus. In College different types of wastes are generated, its collection and management are very challenging.

Solid waste can be divided into three categories: bio-degradable, non-biodegradable and hazardous waste. A bio-degradable waste includes food wastes, canteen waste, wastes from toilets etc. Non-biodegradable wastes include what is usually thrown away in homes and schools such as plastic, tins and glass bottles etc. Hazardous waste is waste that is likely to be a threat to health or the environment like cleaning chemicals, acids and petrol.

Unscientific management of these wastes such as dumping in pits or burning them may cause harmful discharge of contaminants into soil and water supplies, and produce greenhouse gases contributing to global climate change respectively. Special attention should be given to the handling and management of hazardous waste generated in the College. Bio-degradable waste can be effectively utilized for energy generation purposes through anaerobic digestion or can be converted to fertilizer by composting technology. Non-biodegradable waste can be utilized through recycling and reuse. Thus, the minimization of solid waste is essential to a sustainable College. The auditor diagnoses the prevailing waste disposal policies and suggests the best way to combat the problems.

Table 4.1 Different types of waste generated in the College Campus.

Sr.No.	Types of Waste	Particulars
1	Solid wastes	Damaged furniture, paper waste, paper plates, food wastes etc.
2	Plastic waste	Pen, Refill, Plastic water bottles and other plastic containers, wrappers etc.
3	E-Waste	Computers, electrical and electronic parts etc.
4	Glass waste	Broken glass wares from the labs etc.
105	Chemical wastes	Laboratory waste etc.
6	Bio-medical Waste	Sanitary Napkin etc.



Direction
Technology
(Excellence)
Anand Nagar, Bhopai



Bhopal (MP), Year 2021-23



4.2 Waste management Practices adopted by the Institute

Audit team visited various departments, classroom and other areas, to find out waste generation area and waste collection points for further improvement. Details are given in the table.







Figure 4.1 Waste collection bin in Institute campus

Recommendation

It is recommended adopted "5 Bin Waste Collection System" for collect different type of waste generated in Institute premises. At present institute uses 3 dustbin system.



(Excellence)
Anand Nagar, Bhonal





4.3 Waste Collection Points

Audit team visited various departments, class rooms, staff rooms, laboratories to find out waste generation area and waste collection points for further improvement. Details are given in the table 4.2

Table 4.2: Detailed of Waste collection Dust bin system


Sr.no.	Location	No. of dustbins
1	A-block	29
2	B-block	25
3	C-block	27
	Total	81

Observation:

It was observed that institute has 2 dustbin System. There is 81 no of dustbins placed at different location in A,B and C block.

4.4 Vermi-compost Pit:

The institute has compost pit, all types of agriculture and organic waste will be disposed of in this pit, and generated manure will utilized in plant and trees in the campus. It's appreciable.

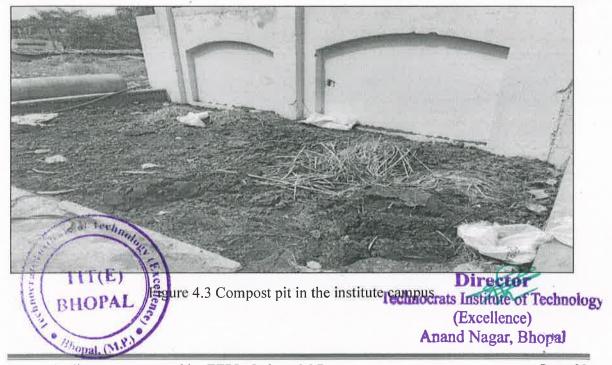





4.5 Organic Waste Composting Machine

The audit team visited in various department and garden and discussion with the management the waste collection process. After audit we recommended for organic waste composting machine for college per day waste generated.



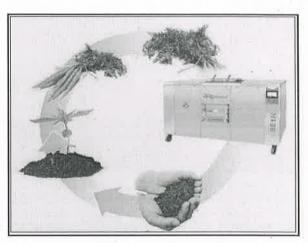


Fig.4.4 Organic Waste composting machine

About Composting Process

An organic waste composting machine is an independent unit that facilitates the composting process and provides better compost. It takes waste as its input and provides manure as its output. Composting without an organic waste composting machine will take a considerable amount of time.

Highly compact composting machine, which uses special microorganisms to break down and decompose all kinds of organic waste into compost within 24 hrs with a volume reduction of 85-90%. When organic waste is added to it, moisture is sensed by the humidity sensor, heater, mixing blades, and an exhaust system.

Recommendation

College has a good potential to install an organic waste composting machine

Fechnocrats Institute of Technology
(Excellence)
Anand Nagar, Bhopal

Green Audit report prepared by EEPL, Indore, M.P.





CHAPTER- 5 QR CODE SYSTEM

5.1 QR Code System

While the world seems to be going digital, people lack the time to read books and process the information they contain. Hence, College can be provided QR codes on the trees for its information and to exploit the rapidly growing platform for a unique purpose.





Fig: 6.1 QR Code System for plants

These codes can give students all the information they need to know about the tree — from its scientific name to its medicinal value. They only need to put their smart-phones to use. QR codes to them, making it easier for everybody to learn about a plant or a tree at the tip of their fingers," If any app generating a QR code, which is available for free on the online stores, can be used to avail the information of the trees.

& Eco-restoration programmes

• Frame long-term eco-restoration programmes for replacing exotic Acacia plantations with indigenous trees and need of the hour is to frame a holistic campus development







END OF THE REPORT THANKS







ENERGY AUDIT REPORT



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)

Anand Nagar, Opp. Hataikheda Dam, BHEL, Bhopal, Madhya Pradesh - 462021

PREPARED BY

Flat No. 201, OM Apartment, 214 Indrapuri Colony, Bhawarkuan, and Technology – 452 001 (M. P.). India 0731 4048831

Email ID:eempirical18@gmail.com

www.eeplgroups.com (2021-23)

Technocrats Institute of Technology (Excellence)

Anand Nagar, Bhopal

Energy Audit report prepared by EEPL, Indore, M.P.

TIT(E)

BHOPAI

Page 1





CONTENTS

Sr. No.	Item	Page No.
I	Acknowledgement	4
П	Certification of Accreditation	5
111	Energy Audit Team	6
IV	Energy Monitoring Committee	7
V	Energy AND Environment Policy	. 9
VI	Policy on Energy and Water Conservation	12
VII	Executive Summary	15
Chapter-1	Introduction	18
1.1	About Institute	18
1.2	About Energy Audit	23
1.3	Objective of Energy Auditing	23
1.4	Methodology	24
Chapter- 2	Power Supply System	25
2.1	Power Supply System	.25
2.1.1	Grid Power	25
2.1.2	Solar Energy	26
2.1.3	DG set	27
Chapter- 3	Electricity Bill Analysis	28
3.1	Annual energy consumption	28
3.2	Monthly Energy Consumption Year 2021-22 & 2022-23	29
3.3	Monthly Demand Analysis Year 2021-22 & 2022-23	30
3.4	Power Factor Analysis Year 2021-22 & 2022-23	31
3.5	Monthly Overall per unit Charges (Analysis Year 2021-22 & 2022-23)	32
Chapter- 4	Connected Load Analysis	33
4.1	Connected Load Detailed	- 33
4,2	Photographs of Lighting System	50
4.3	Photographs of ACs and fans	52
Chapter- 5	Energy Conservation Measures	53
ECM-5.1	Replacement of conventional FTL (T-8) 36W by LED (T-5) 20W	53
ECM-5.2	Replacement of 4x4 sq fitting (18W*4) by 36W LED fitting	53
ECM-5.3	Replacement of 30W CFL by 15W LED	54
ECM-5.4	Replacement of 200W CFL by 100W LED	54
	Replacement of 18W CFL by 9W LED	55
/ECM-5.6	Conventional ceiling fan (50W) Replaced by BLDC fan (28W)	55
	The way of the state of the sta	56
Annexure-I	Direction of the second Analyzon	CT0557
	ABLUC deiling and exhaust fan product catalog Technocrats Institu	melor fach
3	(Exce	lence)
no of Audit	Anand Nav	rar. Bhona

Energy Audit raport prepared by EEPL, Indore, M.P.





Sr. No.	Item	Page No.
Annexure-III	Airtron intelligent microprocessor energy saver product catalog	59







ACKNOWLEDGEMENT

We would like to thank the **Technocrats Institute of Technology (Excellence)**, **Bhopal (M.P.)**. Our appreciation and gratitude to the management for granting us permission to conduct energy audit for the institute

We are genuinely touched by the helpful attitudes and cooperation displayed by all the faculty members and technical staff involved in the audit. Their valuable assistance and cooperation significantly contributed to the successful execution of the audit.

For- Empirical Exergy Private Limited



Rajesh Kumar Singadiya

(Director)

M.Tech (Energy Management),
Accredited Energy Auditor [AEA-0284]
Certified Energy Auditor [CEA-7271]
(BEE, Ministry of Power, Govt. of India)
Empanelled Fitting, Auditor with MPUVN, Bhopal M.P.
Vead Auditor ISO 2001:2011 [EnMS) from FICCI, Delhi
Certified Water Auditor (NPC, Govt. of India)

Chartered Engineer [1699118], The Institution of Engineers (India)

Member (1 ISAIRA 58150]

Pal, (M.Y.)





CERTIFICATE OF ACCREDITATION



BUREAU OF ENERGY EFFICIENCY

Examination Registration No.: EA- 7271

Accreditation Registration No.: AEA-284



Certificate of Accreditation

The certificate is subject to the provisions of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

This certificate shall be valid until it is cancelled under regulation 9 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

On cancellation, the certificate of accreditation shall be surrendered to the Bureau within fifteen days from the date of receipt of order of cancellation.

Your name has been entered at AEA No...284.... in the register of list of accredited energy auditors. Your name shall be liable to be struck out on the grounds specified in regulation 8 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

Given under the seal of the Bureau of Energy Efficiency, Ministry of Power, this 5th day of October, 2018

HOPAL E

Chopal, (M.

Secretary,

Bureau of Energy Efficiency

Technocrats Institute of Technology

(Excellence)

Anand Nagor Bhonal





ENERGY AUDIT TEAM

The audit team constituted by the following senior technical executives from the Empirical Exergy Private Limited,

- ₩ Mr. Rajesh Kumar Singadiya[Director & Accredited Energy Auditor AEA-0284]
- Ms. Laxmi Raikwar [Energy Expert and Report Reviewer]
- ♣ Mr. Ajay Nahra [Sr.Project Engineer]
- Mr. Charchit Pathak [Sr.Project Engineer]
- ➡ Mr. Mohan Choudhary [Electrical Engineer]
- ★ Mr. Praveen Punasiya [Field Engineer]







ENERGY MONITORING COMMITTEE



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



(Run by Chandravadani Mahila Shikshu Samit, Shopal) 21. Fr. Ho - 0755-2741901 fees-0755-2751477 website

TTTE/Dir/2021/059

25,04 2011

We are pleased to announce the formation of a new committee dedicated to advancing our campus's sustainability efforts. The "Clean & Green Campus Initiatives Committee" that will focus on waste management and energy conservation strategies aimed at reducing our environmental footprint

Committee Goals:

- Waste Management: Implementing effective recycling programs, reducing single-use plastics, and promoting sustainable practices across campus.
 Energy Management: Identifying opportunities for energy efficiency, promoting renewable energy sources, and raising awareness about energy conservation.
- Rain Water Harvesting: Help reducing flooding, recharging groundwater resources. Provide a sustainable and environmentally friendly way to conserve water.
- 4. Green Campus Management: Implementing environmental friendly practices and education combine to promote sustainable and eco-friendly practices in the campus

Members of the Committee

and the latest	Name of Member	Designation
S.N.	Name of Mend Civil Engineering	Chairman
3	Dr. Ravindra Gautam, Professor & Head, Civil Engineering	member
(2)	Dr. Ravindra Gautani, Follossor & Head, Mechanical Engineering Dr. Adarsh Sachdeva, Professor & Head, Mechanical Engineering	member
3	Prof. Rahul Arora, Asstt Professor & Head, Electrical Engineering	member
4	Prof. Anil Solanki, Assistant Professor, Civil Engineering	

Objectives:

- Conducting regular audits to assess current waste and energy usage.
- Developing and implementing action plans to achieve waste reduction and energy
- Collaborating with faculty, staff, and students to foster a culture of sustainability on campus.
- Organizing educational campaigns and events to raise awareness about environmental issues

TIT Excellence

Director ituse of Technology d Magar, Bhopal









TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)



11/17/19/2022/064

10,07,2022

Circular

With reference to the circular TTTE/Dir/2021/089, dt. 25.04.2021, we are reframing the "Clean & Green Campa Initiatives Committee" as follows.

Members of the Committee:

	AND	Designation
8.N.	Name of Member	Chairman
1	Dr. Ravindra Gautam, Professor & Hend, Civil Engineering	member
-2	Dr. Manish Joshi, Professor & Head, Mechanical Engineering	member
3	Prof. Rajesh Sahu, Asstt Professor, Electrical Engineering	member
3	Prof. Panka) Dixit, Assistant Professor, Civil Engineering	

Goals & objectives of the committee shall remain as follows.

Committee Coals:

- 1. Waste Management: Implementing effective recycling programs, reducing single-use plastics, and promoting sustainable practices across campus
- 2. Energy Management: Identifying opportunities for energy efficiency, promoting renewable energy sources, and ruising awareness about energy conservation.
- Raio Water Harvesting: Help reducing flooding, recharging groundwater resources. Provide a sustainable and environmentally friendly way to conserve water.
- 4. Green Campus Management: Implementing environmental friendly practices and education combine to promote sustainable and eco-friendly practices in the campus.

Objectives:

- Conducting regular audits to assess current waste and energy usage.
- Developing and implementing action plans to achieve waste reduction and energy
- Collaborating with faculty, staff, and students to foster a culture of sustainability on campus. Organizing educational campaigns and events to raiso awareness about environmental issues.


Director Director Institute of Technology (Excellence) d Nagar, Bhopal







ENERGY AND ENVIRONMENT POLICY

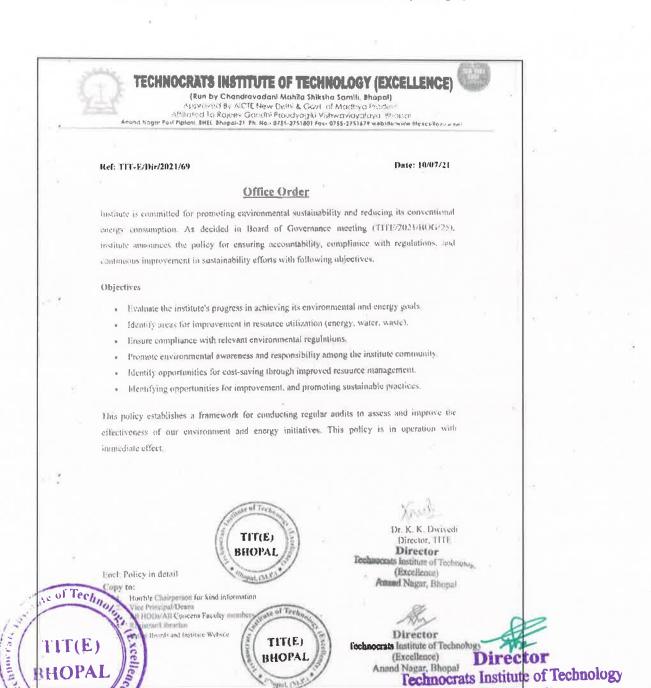

opal, (M.P.)

(Excellence)
Anand Nagar, Bhopal





Policy for Audit on Environment and Energy Initiatives

INTRODUCTION:

Before a leader to the Technical Educational Institution in the state, the institute is committed to develop and implement Green and Sustainable energy-system in the whole campus, which will as a consequence spreadtheawarenessandmotivationinthesociety to move toward clean and sustainable energy resources

SCOPE:

tinspolicyappliestoall stakeholders, students, staff and visitors

COMMITTEE FOR AUDIT:

- · It comprises of senior faculty (preferably Professor) as nominated by Director.
- Three senior faculty members (preferably Professor) as nominated by Director.
- Administrative staff

RESPONSIBILITIES:

- · Audit committee or team will be responsible fordeveloping and implementing the audit plan, analyze data, and prepare reports.
- institute' administrative staff will provide necessary resources and support for conducting
- Faculty and staff will be responsible for implementing and maintaining environmental and energy initiatives.
- They will also cooperate with the audit process and implement recommended actions.
- Students will participate in awareness compaigns and promote environmentally responsible practices.

AUDIT FREQUENCY AND TYPES:

TIT(E)

- Audits will be conducted biannually.
- · It will include Green /Environment audit, Energy audit etc.

The institute confirms its commitment to environment and energy initiatives through the

of Technology BHOPAL

Director echnocrata Institute of Techno (Excellence)

Anand Nagar, Bh





- 11 Green audit? Environment audit
- 2. Imorgy audit
- 33 Clean and green compus initiatives
- 4) Deyond the campus environmental promotion activities

AUDIT DOCUMENTATION:

Audit committee

- Define outline requirements for accumenting audit findings, conclusions, and recommendations.
- Define procedures for communicating audit results to relevant stakeholders, such as institute' administration, faculty, and staff.
- Establish mechanisms for monitoring and tracking implementation of audit recommendations

REVIEW

This policy will be reviewed and updated periodically if necessary to reflect changes in environmental regulations, best practices, and the Institute's evolving sustainability goals.

CONCLUSIONS:

By developing a comprehensive policy that addresses these aspects, the Institute effectively strives to continuously improve its environmental performance and contribute to a more sustainable future.

Dr. K. K. Dweedi
Directol III
Fechnomics Institute of Technology
(Excellence)

Discussed & finalized in meeting of Academic Council (TITE/2021/ACM/25) and submitted for information and approval in Board of Governance meeting.

TIT(E) BHOPAL

of Technoy

opal, (M.

TIT(E)
BHOPAL

Ms. Sadhna Karsoliya Chairpenan, TITE

Director
(echnocrats Institute of Technolog)
(Excellence)
Anand Nagar, Bhopal

Director

(Excellence)

Anand Nagar, Bhopal





POLICY ON ENERGY AND WATER CONSERVATION



TECHNOCRATS INSTITUTE OF TECHNOLOGY (EXCELLENCE)

(Run by Chandravadani Mahilo Shiksha Samifi, Bhapal) Apprayon By Alf LE New Delhi A Clovk, of Manthya Pradest Affaction in Regent Comos Processings Visitors vederones Four Papal Met. Broad J. P. No. 355 275 (8) 4m. 2015 275 (8) webstermen filtesteelin

Ret: TTT-F/Dir/2021/69

Date: 09/07/21

Office Order

traffilite is committed for energy conservation and fostering a culture of environmental responsibility among faculty, staff, and students. As decided in Board of Governance meeting (11TE/2024/BOG/25), institute announces the policy for ensuring energy conservation without the campus with following objectives.

Objectives

- Reduce account energy consumption within the college.
- Promote the use of energy-efficient technologies and practices.
- Exist assumess about energy conservation through education and outreach programs
- Continuously menitor and improve energy efficiency across the softege.

The aim of this policy is to encourage and adopt practices that would lead to sustainable development, minimize curbon foot prints and depletion of natural resources and maximize recycling of resources. This policy is in operation with immediate effect.



Fred Policy in detail

Copy to:

- I Health Charperson for kind information
- Vec Protripal/Deam/QAC Correlantor
- All HODs All Concern Faculty members
- 4 Reguziar/Librarian
- 5. Notice Boards and Institute Website



Director

Dr. K. K. Dwivedi Director, TITE

Director Fechnocrats Institute of Technology (Excellence)

Annad Nagar, Bhopal

Polycetor
Technocrass Institute of Technocrass (Excellence)
Anual Manar, Bhorat



Director
Technocrats Institute of Technology
(Excellence)

Anand Nagar, Bhonal





Policy for Energy & Water Conservation

certainistrate Institute of Technology (Excellence), Bhopal, Madhya Pradesh is fusty construction promoting alternate sources of energy, using posses efficient equipments for sustainable development and indepting environmentally responsible processes, methods to conserve water, efficiently manage the degradable & non degradable wastes, making efforts gross campus, making disabled friendly, barrier free environment etc. The institute is making constant efforts to conserve the natural resources and special awareness about occid to protect the covaronment amongst its students, staff, faculty and community

this policy governs the framing of rules and regulations with respect to using renewable a urces of energy & initiatives and practices.

3 Pelicy:

The aist tare shall

- V. Take Initiatives to make the comput green and clean and conserve energy and water, as also manage waste judiciously.
- Take initiatives for managing the degradable & non degradable wastes, making efforts for disabled friendly & barrier free environment for disabled

4 Key Strategies

. Lighting:

- · Encourage switching off lights in unoccupied rooms.
- Replace traditional mounds count bolhs with LED lighting.
- Maximize natural light mage by opening blinds (if applicable) and strategically placing furniture.

· Equipment:

- Promote the use of energy-efficient appliances and electronics.
- Implement power management settings on computers and other devices.
- Regularly maintain equipment to ensure optimal performance

Heating, Ventilation, and Air Conditioning (HVAC):

- Encourage adjusting thermostats to maintain comfortable yet efficient temperatures
- V. Universatural ventilation whenever possible
- Schedule regular maintenance für HVAC systems.

Renewable Energy:

Explore options for installing solar panels or other suitable renewable cut



Director ocrata Institute of Technology (Excellence) Anand Nagar, Bhopa









- Integrate renewable energy education into corriculum where applicable.
- * Awareness and Education:
 - Organize workshops and seminars on energy conservation practices.
 - Develop and distribute informative materials on energy-saving tips.
 - Recognize and celebrate achievements in energy conservation offorts
- Wastewater Management;
 - Explore options for treating and recycling wastewater for irrigation at mother con-petable uses where applicable.
 - I more proper disposal of wastewner to prevent contamination of water resources.

5. Implementation and Monitoring

- An Energy Management Committee will be established to oversee the implementation and offectiveness of this policy
- . The committee will conduct regular energy audits to Identify areas for improvement.
- The college administration will allocate resources for implementing energy-saving
- Progress towards energy conservation goals will be tracked and reported periodically

6. Review and Revision

It is particly will be reviewed and revised periodically if necessary to reflect best practices and technological advancements.

?. Conclusion

This policy also provides a valuable learning environment for students to understand the importance of water conservation and become responsible water sucre.

Dr. K. K. Dwivedi

Pirele of Technology

Discussed & finalized in meeting of Academic Courcil (TITE/2021/ACM/21) and submitted for

information and approval in Board of Governance meeting

TITLE) BHOPAL



Ms. Sadhin Karsoliya Chalepungey, TITS

Director
Technocrats Institute of Technology
(Excellence)
Anard Near Ellicital







EXECUTIVE SUMMARY

The executive summary of the energy audit report presented in this section briefly outlines the identified energy conservation measures and other recommendations proposed during the project. These energy conservation measures can be implemented in phases to conserve energy and enhance productivity within the **Technocrats Institute of Technology (Excellence)**, campus. The expected total annual energy saving potential is 1, 28,189 (kWh) units.

INITIATIVE TAKEN BY THE INSTITUTE

↓ Lighting System

• The institute has already taken steps to install energy-efficient lighting within the premises. This includes the replacement of conventional tube lights with energy-efficient LED lights. However, there remains significant potential for further improvement.

ENERGY AUDIT RECOMMENDATION

↓ Lighting System

BHOPAL

"pal, (M.Y.)

- ECM-1: There is a good potential to replace 738 numbers of conventional tube light T-8 (36W) by LED-T5 (20W). The expected energy saving potential is 35424 units per year.
- ECM-2: There is a good potential to replace 270 numbers of 4x4 sq. fitting (18Wx4) replaced by 36W LED sq. fitting. The expected energy saving potential is 15552 units per year.
- ECM-3: There is a good potential to replace 25 number of CFL (30W) by 15W LED. The expected energy saving potential is 750 units per year.
- ECM-4: There is a good potential to replace 9 number of CFL (200W) replaced by LED 100W/The expected energy saving potential is 1800 units per year.

ECM-5: There is a good potential to replace 26 numbers of CFL (18W) by LED 9W. The

expedied energy saving potential is 468 units per year.





♣ Ceiling fan

• ECM-6: There is a good potential to replace 1013 number of (60W) conventional ceiling fan by 28W BLDC fan. The expected energy saving potential is 55,715 units per year.

♣ Split ACs

• ECM-7: There is a good potential to install Airtron intelligent microprocessor energy saver in 22 numbers of 2 and 3 ton star rated units. The expected energy saving potential is 18,480 units per year.

★ Timer-Controller and Motion sensor

• It is recommended to install "timer controller and motion sensor in faculty cabins, offices, and non-working areas.

★ Energy Monitoring System

- It was observed that there is a requirement of monthly energy consumption monitoring system to find out the annual energy consumption of the energy center, which should be based on a cloud-based (IoT) energy monitoring system.
- The above system is highly recommended on solar plant and main electrical panel of the department. It serves both energy monitoring purposes and can act as a demonstration project for students and the management.

★ Awareness and Training program

• Conduct awareness and training program, poster presentation to promote energy saving activities in the center.







ENERGY CONSERVATION MEASURES

ECM	Identification Observation Recommendation		Recommendation	Annual Energy Saving (kWh)	Annual cost saving (Rs.)	Investment (Rs.)	Simple Payback period (Year)
ECM:1	738 no. Lighting	FTL-T8 (36W)	Replacement by LED-T5 (20W)	35,424	3,01,104/-	1,47,600/-	0.5
ECM:2	270 no. fixtures	4x4 ft² (18Wx4)	Replacement by 36W 1 sq.x1ft ² LED	15,552	1,32,192/	2,70,000/-	2
ECM:3	25 no. Lighting	CFL (30W)	Replacement by LED (15W)	750	6,375/-	5,000/-	1
ECM:4	9 no. Lighting	CFL (200W)	Replacement by LED 100W	1,800	15,300/-	13,500/-	1
ECM:5	26 no. of	CFL (18W)	Replacement by 9W LED	468	3,978/-	2,600/-	0.7
ECM:6	1013 no. old ceiling fan	Conventional fan (60W)	Replaced by BLDC fan (28W)	55,715	4,73,577/-	28,36,400/-	6
ECM:7	['M'' ton Star rated		Installation of Airtron 'Intelligent Microprocessor' energy saver	18,480	1,57,080/-	1,65,000/	£ 1.1
		Total		1,28,189	10,89,606/-	34,40,100/-	3.16

Note: Energy saving will be depend on working hours and load factor of the equipment's

Energy Audit report prepared by EEPL, Indore, M.P.

Page 17









Chapter-1 INTRODUCTION

1.1 About Institute

Technocrats Institute of Technology (Excellence), Bhopal, MP, is one of the premier institutes of Madhya Pradesh. This is an educational institute which is known in central India for imparting quality & value-based education for the past 12 years. This institute was started with a clear vision to develop the institute into a center of excellence in engineering education in the country with global standards. The institute is affiliated to Rajiv Gandhi Proudyogiki Vishwavidyalaya (RGPV), Bhopal for B.Tech, M.Tech, MCA programs & affiliated to Barkatullah University, Bhopal for MBA program. The institute is located in Anand Nagar, Raisen Road, Bhopal.

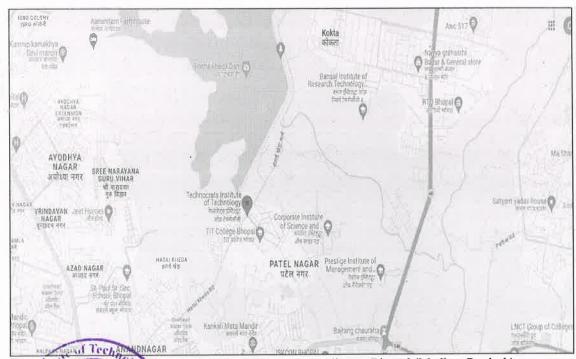


Figure 1. Source: Satellite Image of TIT-Excellence, Bhopal (Madhya Pradesh)

The institute of (ers) six courses at undergraduate level leading to bachelor's degree B. Lech in Electronics (Computer Science Technology Engineering, Electrical Engineering, Mechanical Engineering and CSE (Artificial Intelligence & Anand Nagar, Bhopal





Machine Learning) disciplines. Apart from these courses, institute also offers admissions in master's degree, M.Tech. in Computer Science & Engineering, Construction Technology & Management and CSE (Artificial Intelligence & Machine Learning), Master of Computer Application (MCA) & Master of Business Administration (MBA). Presently the total intake is 600 in UG courses and 450 in PG courses.

Vision of the Institute

To become a "Centre of Excellence" for quality education in the field of engineering, research and management so as to produce globally competent and socially responsible professionals, who can contribute in technological and socio-economic development of the nation as a whole and region in particular.

Mission of the Institute

M.1: To educate students with deep professional knowledge through innovative teaching-learning process and to make them aware of cutting edge technology so as to become capable of understanding and addressing the issues of society, state and the country.

M.2: To create in-house facilities for research and innovation to provide solution to the industrial problems.

M.3: To inculcate right human values and professional ethics, leadership qualities, communication and entrepreneurship skills in students to meet the need of society.

Institute Population

TIT(E)

opal, (M.


Sr. No.	Year	Teaching Staff (No.)	Non -Teaching Staff (No.)	Student (No.)
1 1	2020-21	212	98	2493
2	T2021-22	212	98	2644
igure of	2022-23	213	98	2735

Director






Institute Layout (Ground Floor Plan)

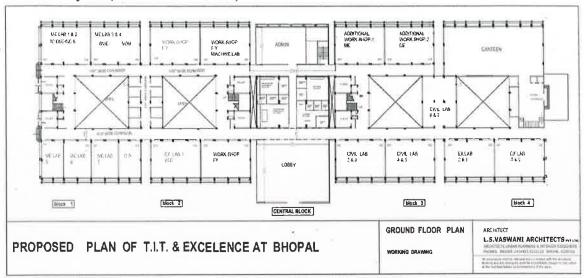


Institute Layout (First Floor Plan)

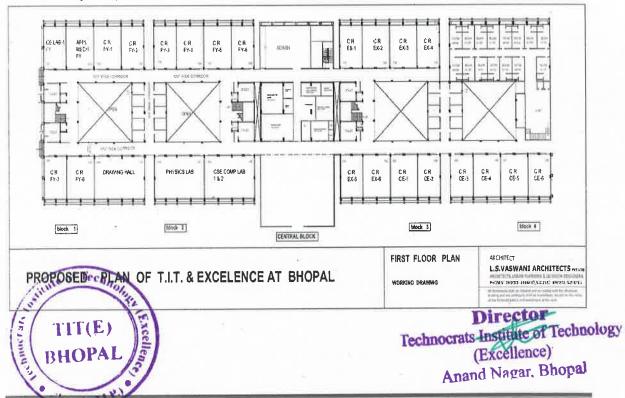







Institute Layout (Second Floor Plan)

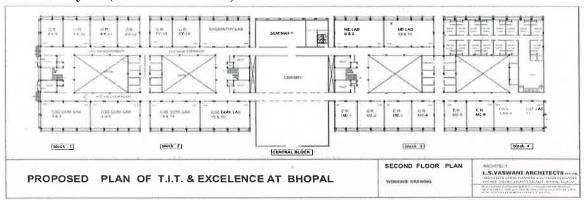

Institute Layout (Third Floor Plan)

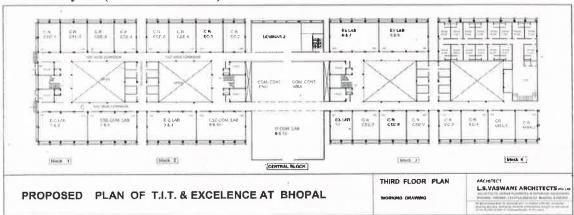

Institute Layout (Fourth Floor Plan)

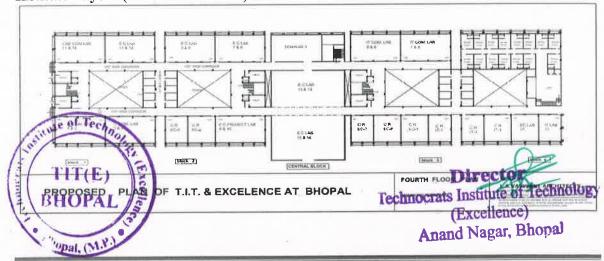



















Energy Audit report prepared by EEPL, Indore, M.P.

Page 22







1.2 About Energy Audit

An energy audit serves to enhance understanding about how energy is utilized within a institute, aiding in the identification of areas susceptible to waste and potential areas for improvement. The overall energy efficiency, from generation to the end consumer, stands at 50%. Therefore, conserving one unit by the end user is equivalent to two units produced at the power plant.

An energy audit represents the most effective approach to discerning the strengths and weaknesses of energy management practices, while also offering solutions to existing issues. It embodies a professional means of responsible utilization of economic, financial, social, and natural resources. Energy audits contribute value to management control and serve as an evaluative method for systems.

Empirical Exergy Private Limited (EEPL), Indore, Madhya Pradesh, conducted an "Energy Audit" on-site to identify gaps in the energy consumption pattern at Technocrats Institute of Technology (Excellence), Bhopal, (MP). A technical report has been prepared in accordance with the requirements of the institute.

1.3 Objectives of Energy Auditing

Energy auditing provides a critical information foundation for an all-encompassing energy conservation initiative, encompassing energy utilization analysis and the evaluation of energysaving measures.

Its objectives include:

- Lidentifying the cost and quality of different energy inputs
- Levaluating the current energy consumption patterns across various operational cost centers
- Lestablishing connections between energy inputs and production outputs.
- Identifying potential areas for thermal and electrical energy conservation.

 Propositing areas of major wastage.

rgy-salving targets for individual cost centers. Technocrats Institute of Technology

med fues for energy conservation and realizing savings. (Excellence)

Anand Nagar, Bhonal

epared by EEPL, Indore, M.P. Energy Audit report





1.4 Methodology

The methodology employed to achieve the designated objectives, encompassing the assessment of current operational status and potential energy savings, encompasses the following steps:

- Let Sending a team of engineers to the site for discussions with concerned officials and supervisors, aiming to gather data and information regarding plant operations and load distribution across the premises. The collected data were analyzed to establish a baseline energy consumption pattern.
- → Utilizing suitable instruments for measurements and monitoring, including continuous and/or time-lapse recording as appropriate, coupled with visual observations to discern energy usage patterns and system losses.
- Leave Conducting trend analysis for costs and consumption patterns.
- Larrying out capacity and efficiency tests on major utility equipment, wherever applicable.
- Lestimating various forms of losses.
- → Performing computations and in-depth analysis of the gathered data, utilizing computerized analysis and relevant techniques where appropriate, to derive conclusions and formulate an effective energy conservation plan to enhance and reduce specific energy consumption.







CHAPTER-2 POWER SUPPLY SYSTEM

2.1 Power supply system

The power supply for the institute is primarily sourced from the grid, solar energy and in case of a power failure, it is supplied by the DG sets.

2.1.1 Grid Power

The institute acquires energy in the form of electricity procured from the Madhya Pradesh Madhya Kshetra Vidyut Vitaran co. Ltd. Bhopal with the help of 33 KV power supply under tariff HV-3.2B Non- industrial feeder. The power is drawn by 500 KVA Step down transformer at 433Voltage. The Detailed of above transformer is given in table 2.1

Table 2.1: Technical Specification of 500 KVA Transformer

Sr. No.	Items	Technical Specification
.1	Make	CG
2	Year	2013
3	Rating (KVA)	500
4	Voltage (HV/LV)	33000/433
5	Current Rating (HV/LV)	8.75/666
6	Frequency (Hz)	50
7	Type of cooling	ONAN






Fig. 2.1 Transformer (500 KVA) at 33 KV Sub-station Anand Nagar, Bhopal






2.1.2 Solar Energy

The institute has 5 KWp solar energy off grid roof top system. During the audit, System is under working. The detailed of Solar panels are given in table 2.2

Table: 2.2 Solar system technical Specification

Sr. No.	Description	Solar Panel Type-I	Solar Panel Type-I	Solar Panel Type-I	
1	Make	Fujiyama	Luminous	Topsun	
2	Model	UTL 335W-24V	PSS-24325	TEL 12P100	
- 3	Rated Power (P _{max})	Rated Power (P _{max}) 335 W		100W	
4	Rated Voltage (P _{max})	39.01 V	38 V	17.5 V	
5	Rated Current(Imp)	8.60 A	8.55 A	5.79 A	
6	Open Circuit Voltage (Voc)	46.15 V	45.5V	21.5 V	
7	Short Circuit Current (Isc)	9.09 A	9.07A	6.38 A	
8	Output tolerance	0 to +3%	3%	3%	
9	Maximum System Voltage	1000 V	1000 V	1000 V	
10	Module Efficiency	17.70%	NA	NA	

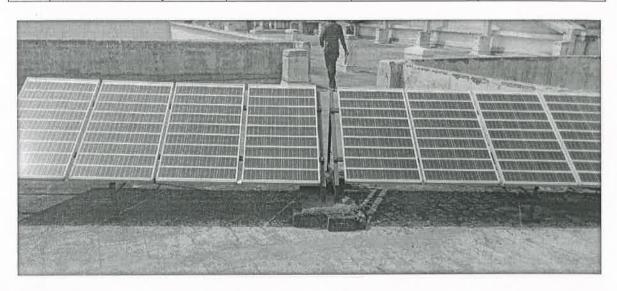

Observation:

It was observed that there is the requirement of energy monitoring system. It will help to monitor energy generation by the system per day. It will also help to determine performance assessment Technocrats Institute of Technology and Capacity Altilization Factor of the system. The expected energy generation 350 kWh/KWp/Day is 6388 units per year.

Anand Nagar, Bhopal





2.1.3 DG Set

The institute has 125 KVA DG set, is used in case of grid power supply is interrupted. During the audit, System is under working. The detailed of DG set given in table 2.3

Table: 2.3 DG Set technical Specification

Sr. No.	Parameter	Description	Unit
1	Make	Greaves Cotton Ltd.	
2	Model No.	GPWII-PII-125	
3	Rated Capacity	125	kVA
4	Rated Voltage	415	V
5	Rated Current		Amp
6	Power Factor	0.8	Ø
7	Frequency	50	Hz
8	Rated Speed	1500	Rev/Min



Observation:

- Desert is used only in case of grid power is interrupted.
- + Annual diesel consumption was 1270 lit. in year 2021-22 and 830 lit for the year 2022-23.
- There is requirement of energy meter to maintain record of energy generation by the system.

 It will help to determine Specific Energy generation of the DG Set (kWh/Lited Fuel) and the system.

Anand Mages Shonal

Jopal, (M.





CHAPTER-3 ELECTRICITY BILL ANALYSIS

3.1 Annual Energy Consumption:

The institute fulfill the requirement of energy consumption from grid power and solar energy generation by off grid solar power system. The detailed of annual energy consumption and overall per unit charges from grid supply in last 2 year is given in table 3.1.1 and share of solar energy is given in table 3.1.2

Table 3.1.1: Annual Energy consumption of Grid Year 2021-22 and 3022-23

Year	Unit Consumption (kWh/Year)	Annual Bill Amount (Rs.)	Overall Per Unit Charges (Rs./kWh)
2021-22	390751	4561901	11.67
2022-23	499663	5493753	10.99

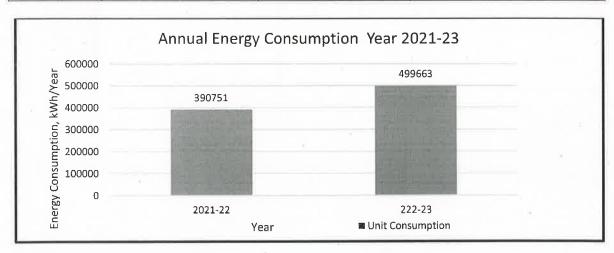


Table 3.1.2: Solar energy and Grid power consumption share

Year	Grid Unit Consumption	Solar Unit Generation	Total Energy Consumption (kWh/Year)	Share (%)
2021-22	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	7300	3,98,051	1.83
2022-23	4,99,663	6388	5,06,051	1.26

Observation: The solar energy share is 1.26 % to 1.83 % of the total energy consumption of the institute. HOPAL (Excellence)

Apard Navar Bhopal






3.2 Monthly Energy Consumption (Year 2021-22 & 2022-23)

Monthly Energy Consumption compares the unit energy consumption for the years 2021-22 and 2022-23 of the institute.

Table 3.2: Monthly Energy Consumption Year 2021-22, and Year-2022-23

Sr. no	Month	Unit Consumption (2021-22)			Current Month Bill (Rs.)
1	April	29786	560275	50685	560275
2	May	29011	345390	70689	774443
3	June	36084	391944	66285	684566
4	July	43010	429825	47348	531526
5	August	36633	392862	37668	429297
6	September	35684	377970	41076	443062
7	October	35355	378601	36069	395867
8	November	28631	333811	31982	355334
9	December	30308	336460	29592	324661
10	January	29162	348950	30148	342415
11	February	29025	343889	29006	327702
12	March	28062	321924	29115	324605
13	Total	3,90,751	45,61,901/-	4,99,663	54,93,753/-

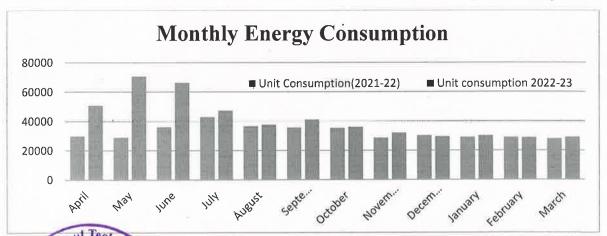

ig. 322 Monthly energy consumption for the year 2021-22, year 2022-23

bservations (E)

an increase in monthly energy consultributorats institute of Technology (Excellence)

ared to 2021-22, especially noticeable during the summer months nand Nagar, Bhopal





3.3 Monthly Demand Analysis (Year 2021-22 & 2022-23): Maximum Demand Consumption compares the maximum demand in KVA (kilovolt-amperes) for two different periods: 2021-22 and 2022-23, over a span of 12 months from April to March.

Table 3.3: Monthly Maximum Demand (Year 2021-22 & 2022-23)

Sr.	Month &	Contract	Maximum Demand	Billing Demand	Maximum Demand	Billing Demand
No.	Year	Demand	(2021-	22)	(2022-2	23)
1	April	200	112	180	269	269
2	May	200	160	180	309	309
3	June	200	136	180	165	270
4	July	200	163	180	258	258
5	August	200	136	180	213	213
6	September	200	128	180	186	186
7	October	200	180	180	150	180
8	November	200	141	180	128	180
9	December	200	113	180	98	180
10	January	200	105	180	107	180
11	February	200	107	180	93	180
12	March	200	165	180	181	181

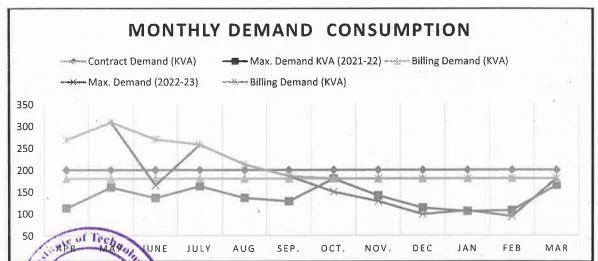


Fig.3.3 Month. Maximum Demand for the year (2021-22) and year (2022-23)

Observations: For the Beriod 2022-23, The maximum demand is highest in May (309 KVA) and (Excellence)

lowest in February (33 KVA).

Anand Nagar, Bhopal

Energy Audit report prepared by EEPL, Indore, M.P.






3.4 Monthly Power Factor Analysis (Year 2021-22 & 2022-23): Monthly power factor analysis for two different periods: 2021-22 and 2022-23, over a span of 12 months.

Table 3.4 Monthly Power Factor (Year 2021-22 & 2022-23)

Sr. No.	Month	Average Power Factor (2021-22)	Average Power Factor (2022-23)
1	April	0.836	0.924
2	May	0.865	0.903
3	June	0.840	0.976
4	July	0.876	0.893
5	August	0.844	0.865
6	September	0.868	0.912
7	October	0.868	0.936
8	November	0.818	0.949
9	December	0.845	0.998
10	January	0.811	0.988
11	February	0.815	0.990
12	March	0.853	0.990
	Average	0.845	0.944

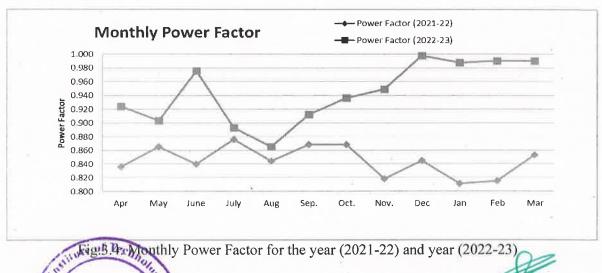

Observation:

The average power factor was 0.845 for the year 2021-22, its shows a significant improvement hology (Excellence)

0.944 in the year 2022 23. Still there is good potential for improvement up to the Yagar, Bhopal






3.5 Monthly Overall per unit Charges:

The unit charges represent the cost of electricity per kilowatt-hour. The unit charges for each month in the years 2021-22 and 2022-23, along with their averages.

Table 3.5 Energy Charges unit charges (Year 2021-22 & 2022-23)

Sr. No	Month	Unit Charges (Rs./kWh) 2021-22	Unit Charges (Rs./kWh) 2022-23
1	April	18.81	11.05
2	May	11.91	10.96
3	June	10.86	10.33
4	July	9.99	11.23
5	August	10.72	11.40
6	Sep	10.59	10.79
7	Oct	10.71	10.98
8	Nov	11.66	11.11
9	Dec	11.10	10.97
10	Jan	11.97	11.36
11	Feb	11.85	11.30
12	March	11.47	11.15
	Average	11.80	11.05

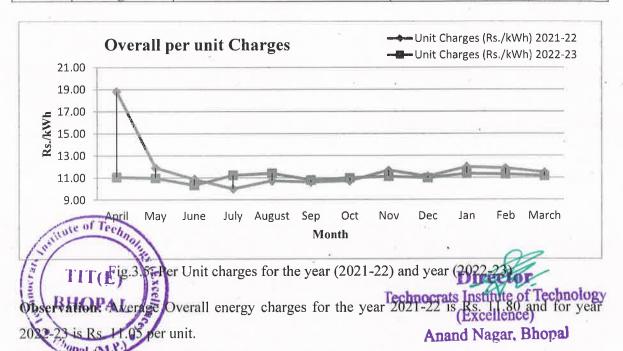





CHAPTER-4 CONNECTED LOAD ANALYSIS

4.1 Connected Load Detailed

During the energy audit details of the electrical appliances has been verified in the institute building. Details of the electrical appliances is given in the table 4.1

Table-4.1 Details of the lighting, load

Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
1	A01		5	0	0	0	0	0	0	0	0	0	0	0
2	A02		0	7	0	0	0	0	0	0	0	0	0	0
3	A 03		4	0	0	0	0	0	0	0	0	0	0	0
4	A 04	Office	0	. 0	1	0	0	0	0	0	0	0	0	0
5		Director's	0	0	0	4	0	0	0	0	. 0	0	0	0
6		Executive director office	0	0	16	4	5	0	0	0	0	0	0	0
7	A 05	Electrical lab	8	0	0	0	0	0	0	0	0	0	0	0
8		RAC lab	4	0	0	0	0	0	0	0	0	0	0	0
9	A 07		4	0	0	0	0	0	0	0	0	0	0	0
10	A 09	7.	_ 2	0	0	0	0	0	0	0	0	0	0	0
11	A 10		8	0	0	0	0	0	0	0	0	0	0	0
12	A 12		8	0	0	0	0	0	0	0	0	0	0	0
13	A 13 + A14	Strength of material	16	0	0	0	0	ō	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 33







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
		Inb												5
14		Staff wash	1	0	0	0	0	0	0	0	0	0	0	0
15	A 101		3	0	0	0	0	0	0	0	0	0	0	0
16	A 102		4	0	0	0	0	0	0	0	0	0	0	0
17	A 103		4	0	0	0	0	0	0	0	0	0	0	0
18	A104		8	0	0	0	0	0 '	0	0	0	0	0	0
19	A 105		0	5	0	0	0	0	0	0	0	0	0	0
20	A 106		6	0	0	0	0	0	0	0	0	0	0	0
21	A 111		4	0	0	0	0	0	0	0	0	0	0	0
22	A 112		4	0	0	0	0	0	0	0	0	0	0	0
23	A113		4	0	0	0	0	0	0	0	0	0	0	0
24	A 114		4	0	0	0	0	0	0	0	0	0	0	0
25	A 115		4	0	0	0	0	0	0	0	0	0	0	0
26	A 116		4	0	0	0	0	0	0	0	0	0	0	0
27	A 117		4	0	0	0	0	0	0	0	0	0	0	0
28	A 118		4	0	0	0	0	0	0	0	0	0	0	0
29	A 107	WASH ROOM	0	0	0	0	0	0	0	0	0	0	0	0
30	A109		10_	0	20	0	5	0	0	0	0	0	_ 0	0
31	A 201		2	0	0	0	0	0	0	0	0	0	0	0
32	A 202		12	0	0	0	0	0	.0	0	0	0	0	0
33	A 202 II		0	0	16	0	0	8	0	0	0	0	0	0
34	A 203		0	0	0	0	0	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 34







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
35	A 209		4	0	0	0	0	0	0	0	0	0	0	0
36	A 210		4	0	0	0	0	0	0	0	0	0	0	0
37	A 211		4	0	0	0	0	0	0	0	0	0	0	0
38	A 212		4	0	0	0	0	0	0	0	0	0	0	0
39	A 213		4	0	0	0	0	0	0	0	0	0	0	0
40		Male wash room		1	0	0	0	0	0	0	0	0	0	0
41	A 301		2	0	0	0	0	0	0	0	0	0	0	0
42	A 302		0	0	8	0	0	0	0	0	0	0	Ò	0
43	A 303		0	0	8	0	0	0	0	0	0	0	0	0
44	A 305		0	0	16	0	0	: 0	0	0	0	0	0	0
45	A 306-307		0	0	16	0	0	0	0	0	0	0	0	0
46	A 308-309		0	0	16	0	0	0	0	0	0	0	0	0
47	A 310		0	2	0	0	0	0	0	0	0	0	0	0
48	A 312		3	0	0	0	0	0	0	0	0	0	0	0
49	A 313		3	0	0	0	0	0	0	0	0	0	0	0
50	A 314		3	0	0	0	0	0	0	0	0	0	0	0
51	A 315		3	0	0	0	0	0	0	0	0	0	0	0
52	A 316		3	0	0	0	0	0	0	0	0	0	0	0
53	A 317		3	0	0	0	0	0	0	0	0	0	Ō	0
54	A 318		3	0	0	0	0	0	0	0	0	0	0	0
55	A 319		3	0	0	0	0	0	0	0	0	0	0	0
56	WASH ROOM		1	0	0	0	0	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 35







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL, 200W	LED 120W
57	A 401		0	0	0	0	0	0	0	0	0	0	.0	0
58	A 402		4	0	0	0	0	0	0	0	0	0	0	0
59	A 403		12	0	0	0	0	0	0	0	0	0	0	0
60	A 404		4	0	0	0	0	0	0	0	0	0	0	0
61	A 405		4	0	0	0	0	0	0	0	0	0	0	0
62	A406-407		0	0	14	0	0	0	0	0	0	0	0	0
63	A 408-409		0	0	16	0	0	0	0	0	0	0	0	0
64	A 410		0	0	8	0	0	0	0	0	0	0	0	0
65	A 411-412		0	0	16	0	0	0	0	0	0	0	0	0
66	A 413		4	0	0	0	. 0	0	0	0	0	0	0	0
67	A 414		4	0	0	0	0	0	0	0	0	0	0	0
68	A 415-416		0	0	16	0	0	0	0	0	0	0	0	0
69		Dept, of EC	0	0	20	0	0	0	0	0	0	0	0	0
70	B block	Material testing lab	8	0	0	0	0	0	0	0	0	0	0	0
71	B03	Geo technical lab	8	0	0	0	0	0	0	0	0	0	0	0
72	B04	Transform ation Engg Lab	8	0	0	0	0	0	0	0	0	0	0	0
73	B 05	Project lab	8	0	0	0	0	0	0	0	0	0	0	0
74	B 06	Electrical machine lab	16	0	0	0	0	0	0	0	0	0	0	0
75	B 07	Store	16	0	0	0	0	0	0	0	0	0	0	.0
76	B 08		10	0	0	0	0	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 36







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
77	B 09	Conferenc e hall	8	0	0	0	0	0	0	0	0	0	0	0
78	B 10		7	1	0	0	0	0	0	0	0	0	0	0
79	B 11	Registrar office	16	0	0	0	0	0	0	0	0	0	0	0
80	B 12		1	- 0	0	0	0	0	0	0	0	0	0	0
81	B 13		1	0	. 0	0	0	0	0	0	0	0	0	0
82		Corridor	8	· I	0	0	0	0	0	0	0	0	0	0
83	B 101	Wash 100m	- 1	0	0	0	0	0	0	0	0	0	0	0
84	B 102	Civil Engg Lab	8	0	0	0	0	0	0	0	0	0	0	0
85	B 103	Engg Geology Iab	8	0	0	0	0	0	0	0	0	0	0	0
86	B 104	B.M.E Lab	8	0	0	0	0	0	0	0	0	0	0	0
87	B 105	Class	8	0	0	0	0	0	0	0	0	0	0	0
88	B 106	Class room	8	0	0	0	0	0	0	0	0	0	0	0
89	B 107	Class room	8	0	0	0	0	0	0	0	0	0	0	0
90	B 108	Class	8	0	0	0	0	0	0	0	0	0	0	- 0
91	B 109	Store room	8	0	0	0	0	0	0	0	0	0	0	0
92	B 110	Dept. of Civil Engg. Office	0	0	5	2			0	0	0	0	0	0
93	B 111	Civil Library	8	0	0	0	0	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 37







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 183V	LED Down lighter 1837	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
94	B 112	Class room	8	0	0	0	0	0	0	0	0	0	0	0
95	В 113	Class	8	0	0	0	0	0	0	0	0	0	0	0
96	B 114	Class room	8	0	0	0	0	0	0	0	0	0	0	0
97	B 115	Wash room	1	0	0	0	0	0	0	0	0	0	0	0
98	B 116	staff wash room		1	0	0	0	0	0	0	0	0	Q	0
99	B 201	Wash room	1	1	0	0	0	0	0	0	0	0	0	0
100	B 202	CAD Lab	8	0	0	0	0	0	0	0	0	0	0	0
101	B 203	Class	8	0	0	0	0	0	0	0	0	0	0	0
102	B 204	Class room	8	0	0	0	0	0	0	0	0	0	0	0
103	B 205	Class room	8	0	0	0	0	0	0	0	0	0	0	0
104	B 206	tutorial room	8	0	0	0	0	0	0	0	0	0	0	0
105	B 207	Class	8	0	0	0	0	0	0	0	0	0	0	0
106	B 208	NCC Office	8	0	0	0	0	0	0	0	0	0	0	0
107	B 209	Yoga meditation	8	0	0	0	0	0	0	0	0	0	0	0
108	B 210	Dept of Elec. & Electronic HOD		0	2	0 %	5	18	0	0	0	0	0	0
109	B 211	Control System lab	16	0	0	0	0	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 38







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
110	B 212		16	0	0	0	0	0	0	0	0	0	0	0
111.	B 213	Wash 100m	ij	Ť	0	0	0	0	0	0	0	0	0	0
112	B 214	Wash room (male)	10	0	0	0	0	0	0	0	0	0	0	0
113		Corridor	10	4	0	0	0	0	0	0	0	0	0	0
114	B 301	Wash room Boys	ã	0	0	0	0	0	0	0	0	0	0	0
115	B 302	tutorial room	8	0	0	0	0	0	0	0	0	0	0	0
116	В 303	tutorial room	8	0	0	0	0	0	0	0	0	0	0	0
117	B 304	PG research Lab	0	0	0	0	0	0	0	0	0	0	0	0
118	B 305	Software Engg	16	0	0	0	0	0	0	0	0	0	0	0
119	B 306	tutorial 100m	8	0	0	0	0	0	0	0	0	0	0	0
120	В 307	Class room	8	0	0	0	0	0	0	0	0	0	0	0
121	B 308	Computer Networkin g lab	0	0	16	0	0	0	0	0	0	0	0	0
122	B 309	T & P Cell	0	0	20	0	5	0	0	0	0	0	0	0
123	B 310	T&P Hall	12	0	0	0	0	0	0	0	0	0	0	0
124	B 311	Seminar hall	12	0	0	0	0	0	0 12	0	0	0	0	0
125	B 312	Wash Room Boys	1	0	0	0	0	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 39







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72\V	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
126	B 313	Wash room girls	1	0	0	0	0	0	0	0	0	0	0	0
127	B 401	Wash Room Boys	(1	0	0	0	0	0	0	0	0	0	0	0
128	B 402	Class room	16	0	0	0	0	0	0	0	0	0	0	0
129	B 403	Class room	16	0	0	0	0	0	0	0	0	0	0 ,	0
130	B 404	EDC Project Lab	16	0	0	o	0	0	0	0	0	0	0	0
131	B 405	tutorial room	8	0	0	0	Ó	0	0	0	. 0	0	0	0
132	B 406		8	0	0	0	0	0	0	0	0	0	0	0
133	B 407		0	0	20	0	- 5	0	0	0	0	0	0	0
134	B 408	Class room	16	0	0	0	0	0	0	0	0	0	0	0
135	B 409	T&P Hall	16	0	0	0	0	0	0	0	0	0	0	0
136	B 410	Wash room	1	0	0	0	0	0	0	0	0	0	0	0
137	B 411	Wash room	I	0	0	0	0	0	0	0	0	0	0	0
138	C 102	Conferenc e hall	0	0	0	0	0	0	8	0	0	0	0	0
139	C 103	Conferenc e hall	0	0	0	0	0	0	8	0	0	0	0	0
140	C 101	Guest	0	0	0	0	0	0	9	0	0	0	0	0
141	C 301		0	4	0	0	0	0	0	0	0	0	0	0
142	C 302		0	0	0	0	0	0 ,	18	0	0	0	0	0
143		Seminar hall T&P	0	0	0	0	0	0	16	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 40







Sr.	Location	Name	FTL 36W	LED tube 20W	Down light 4*4 (18*4) 72W	Down light4*4 (10*4) 40W	CFL Down Light 30W	CFL 18W	LED Down lighter 18W	Led Down Lighter 50W	LED 9W	LED 50W	CFL 200W	LED 120W
144		PPT Hall	0	0	0	0	0	0	66	64	0	0	0	0
145	Boys Hostel		12	45	0	0	0	0	0	0	45	0	0	0
146	GYM		10	0	0	0	0	0	0	0	0	5	9	0
147		Campus Street Light	0	0	0	0	0	o	0	0	0	0	0	10
	То	tal	738	73	270	10	25	26	125	64	45	5	9	10

Energy Audit report prepared by EEPL, Indore, M.P.

Page 41







Electrical Appliance Load Share percentage of the Institute

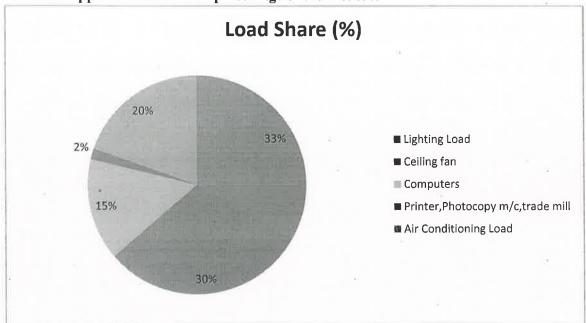


Fig.4.1: Load Share of the TIT Excellence Building

Sr. No.	Appliances	Load Share (%)
1	Lighting Load	33.3
2	Ceiling fan	30.4
3	Computers	15.1
4	Printer, Photocopy m/c, trade mill	1.6
5	Air Conditioning Load	19.6
		100

Observation:

'opal, (M.Y.)

It is observed that lighting load is dominated with 33.3% of the total load while ceiling fan load is 30.4%.

Energy Audit report prepared by EEPL, Indore, M.P.

Director Page 42
Technocrats Institute of Technology
(Excellence)

(Excellence)

nen honal





Table 4.2: Details of the other electrical appliance load like AC, Computer, printer, photocopy m/c etc.

Sr.	Location	Name	Fan	PC	Printer	Photo Copy. machine	AC	Wall fan	Trade mill
1	A01		6	0	0	0	0	0	0
2	A02		6	3	1	1	0	0	0
3	A 03		6	0	0	0	0	0	0
4	A 04	Office	2	2	1	0	0	0	0
5		Director room	2	1	1	0	1	0	0
6	-	EXECUTIVE director office	10	30	· 1 *	1	2	0	0
7	A 05	Electrical lab	12	0	0	0	0	0	0
8		RAC lab	6	0	0	0	0.	0	0
9	A 07		4	0	0	0	0	0	0
10	A 09		1	0	0	0	0	0	0
11	A 10		12	0	0	0	0	0	0
12	A 12		12	0	0	0	0	0	0
13	A 13 + A14	Strength of material lab	24	0	0	0	0	0	0
14		Staff wash room	0	0	0	0	0	0	0
15	A 101		1	2	0	0	0	1	0
16	A 102		6	0	0	0	0	0	0
17	A 103		6	0	0	0	0	0	0
18	A104		12	0	0	0	0	0	0
19	A 105		9	0	0	0	0	.0	0
20	A 106	77	12	0	0	0	0	0	0
21	A 111		6	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 43







Sr.	Location	Name	Fan	PC	Printer	Photo Copy. machine	AC	Wall fan	Trade mill
22	A 112		6	0	0	0	0	0	0
23	A113		6	0	0	0	0	0	0
24	A 114		6	0	0	0	0	0	0
25	A 115		6	0	0	0	0	0	0
26	A 116		6	0	0	0	0	0	0
27	A 117		6	0	0	0	0	0	0
28	A 118		6	0	0	0	0	0	0
29	A 107	Wash room	0	0	0	0	0	0	0
30	A109		0	0	0	0	0	0	0
31	A 201		1	1	1	0	1	0	0
32	A 202		24	4	2	0	0	0	0
33	A 202 II		12	57	0	0	0	0	0
34	A 203		12	51	0	0	0	0	0
35	A 209		6	0	0	0	0	0	0
36	A 210		6	0	0	0	0	0	0
37	A 211		6	0	0	0	0	0	0
38	A 212		6	0	0	0	0	0	0
39	A 213		6	0	0	0	0	0	0
40		Male wash room		0	0	0	0	0	0
41	A 301		1	0	0	0	0	0	0
42	A 302		6	0	0	0	0	0	0
43	A 303		6	0	0	0	0	0	0
44	A 305		12	54	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 44







Sr.	Location	Name	Fan	PC	Printer	Photo Copy. machine	AC	Wall fan	Trade mill
45	A 306-307		12	0	0	0	0	0	0
46	A 308-309		12	54	0	0	2	0	0
47	A 310		0	4	1	0	1	0	0
48	A 312		6	0	0	0	0	0	0
49	A 313		6	0	0	0	0	0	0
50	A 314		6	0	0	0	0	0	0
51	A 315		6	0	· 0	0	0	0	0
52	A 316		6	0	0	0	0	0	· 0
53	A 317		6	0	0	0	0	0	0
54	A 318		6	0	0	0	0	0	0
55	A 319		6	0	0	0	0	0	0
56	Washroom		0	0	0	0	0	0	0
57	A 401		0	0	0	0	0	0	0
58	A 402		6	0	0	0	0	0	0
59	A 403		18	0	0	0	0	0	0
60	A 404		6	0	0	0	0	0	0
61	A 405	1 %	6	0	0	0	0	0	0
62	A406-407		10	0	0	0	0	0	0
63	A 408-409		12	0	0	0	0	0	0
64	A 410		6	0	0	0	0	0	0
65	A 411-412		12	0	0	0	0	0	0
66	A 413		6	0	0	0	0	0	0
67	A 414		6	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 45







Sr.	Location	Name	Fan	PC	Printer	Photo Copy. machine	AC	Wall fan	Trade mill
68	A 415-416		12	60	0	0	0	0	0
69		Dept, of EC	10	2	0	0	1	0	0
70	B block	Material testing lab	6	0	0	0	0	0	0
71	B03	Geo technical lab	6	0	0	0	0	0	. 0
72	B04	Transformation Engg Lab	6	0	0	0	0	0	0
73	B 05	Project lab	6	0	0	0	0	0	0
74	В 06	Electrical machine lab	12	0	0 *	0	0	0	0
75	B 07	Store	12	0	0	0	0	0	0
76	B 08		5	0	0	0	0	0	0
77	B 09	Conference hall	0	0	0	0	0	0	0
78	B 10		6	0	0	0	0	0	0
79	B 11	Registrar office	11	10	4	0	0	0	0
80	B 12		0	0	0	0	0	0	0
81	B 13		0	0	0	0	0	0	0
82		Corridor	0	0	0	0	0	0	0
83	B 101	Wash room	0	0	0	0	0	0	0
84	B 102	Civil Engg. Lab	6	0	0	0	0	0	0
85	B 103	Engg. Geology lab	6	0	0	0	0	0	0
86	B 104	B.M.E Lab	6	0	0 -	0	0	0	0
87	B 105	Class room	6	0	0	0	0	0	0
88	B 106	Class room	6	0	0	0	0	0	0
89	B 107	Class room	6	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 46







Sr.	Location	Name	Fan	PC	Printer	Photo Copy. machine	AC	Wall fan	Trade mill
90	B 108	Class room	6	0	0	0	0	0	0
91	B 109	Store room	6	0	0	0	0	0	0
92	B 110	Dept. of Civil Engg. Office	10	1	0	0	1	0	0
93	B 111	Civil Library	6	0	0	0	0	0	0
94	B 112	Class room	6	0	0	0	0	0	0
95	B 113	Class room	6	0	0	0	0	0	0
96	B 114	Class room	6	0	0	0	0	0	0
97	B 115	Wash room		0	0	0	0	0	0
98	B 116	staff wash room		0	0	0	0	0	0
99	B 201	Wash room		0	0	0	0	0	0
100	B 202	CAD Lab	6	0	0	0	0	0	0
101	B 203	Class room	6	0	0	0	0	0	0
102	B 204	Class room	6	0	0	0	0	0	0
103	B 205	Class room	6	0	0	0	0	0	0
104	B 206	tutorial room	6	0	0	0	0	0	0
105	B 207	Class room	6	0	0	0	0	0	0
106	B 208	NCC Office	6	0	0	0	0	0	0
107	B 209	Yoga meditation	6	0	0	0	0	0	0
108	B 210	Dept of Elec. & Electronic Hod	10	1	0	0	0	0	0
109	B 211	Control System lab	12	0	0	0	0	0	0
110	B 212		12	0	0	0	0	0	0
111	B 213	Wash room	0	0	0	0	0	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 47







Sr. no	Location	Name	Fan	PC	Printer	Photo Copy. machine	AC	Wall fan	Trade mill
112	B 214	Wash room (male)	0	0	0	0	0	0	0
113		Corridor	0	0	0	* 0	0	0	0
114	B 301	Wash room Boys	0	O	0	0	0	0	0
115	B 302	tutorial room	6	0	0	0	0	0	0
116	B 303	tutorial room	6	0	0	0	0	0	0
117	B 304	PG research Lab	Lock	0	0	0	0	0	0
118	B 305	Software Engg	12	30	0	0	0	0	0
119	B 306	tutorial room	6	0	0	0	0	0	0
120	B 307	Class room	6	0	0	0	0	0	0
121	B 308	Computer Networking lab	12	60	0	0	0	0	0
122	B 309	T & P Cell	10	1	1		1	0	0
123	B 310	T&P Hall	16	0	0	0	0	0	0
124	B 311	Seminar hall	16	0	0	0	0	0	0
125	B 312	Wash Room Boys	0	0	0	0	0	0	0
126	B 313	Wash room girls	0	0	0	0	0	0	0
127	B 401	Wash Room Boys	0	0	0	0	0	0	0
128	B 402	Class room	12	0	0	0	0	0	0
129	B 403	Class room	12	0	0	0	0	0	0
130	B 404	EDC Project Lab	12	0	0	0	0	0	0
131	B 405	tutorial room	6	0	0	0	0	. 0	0
132	B 406		6	0	0	0	0	0	0
133	B 407		10	3	- 0	0	0-	0	0

Energy Audit report prepared by EEPL, Indore, M.P.

Page 48







Sr.	Location	Name	Fan	PC	Printer	Photo Copy, machine	AC	Wall fan	Trade mill
134	B 408	Class room	12	0	0	0	0	0	0
135	B 409	T&P Hall	12	0	0	0	0	0	0
136	B 410	Wash room	0	0	0	0	0	0	0
137	B 411	Wash room	0	0	0	0	0	0	0
138	C 102	Conference hall	6	0	0	0	2	0	0
139	C 103	Conference hall	6	0	0	0	2	0	0
140	C 101	Guest room	2	0	0	0	1	0	0
141	C 301		3	0	0	0	0	0	0
142	C 302		12	0	0	0	0	0 =	~ 0
143		Seminar hall T&P	12	0	0	0	0	0	0
144		PPT Hall	38	0	0	0 -	5	0	0
145	Boys Hostel		45	0	0	0	2:	0	0
146	GYM		0	0	0	0	0	0	2
147		Campus Street Light	0	0	0	0	0	0	0
		Total	1013	431	13	2	22	1	2

Energy Audit report prepared by EEPL, Indore, M.P.

Page 49












4.2 Photographs of lighting system














Energy Audit report prepared by EEPL, Indore, M.P.

Page 50







Table 4.4: Details air-conditioning load (window and split AC)

Sr. no	Block	Location	AC	Make	Cooling capacity (Ton)	Type	Rating Star	Year
1	-	Director room	1	Voltas	2	Split	3	2013
2	- 19	Executive director office	2	Voltas	2	Split	3	2013
3	Ground floor	Conference hall	1	Blue star	2	Split	3	2024
4	A 201	72	1	Camipro	1.5	Split	2	2020
5	A 308-309	¥	2	LG	1.5	Split	2	2010
6	A 310	-	1	Videocon	1.5	Window	NA	2010
7		Dept. of EC	1	Blue star	1.5	Split	3	2011
8	B 110	Dept. of Civil Engg. Office	1	Blue star	1.5	Split	3	2011
9	C 102	Conference hall	2	Blue star	2	Split	3	2023
10	B 305	DBMS Skill dept.	1	LG	1.5	Split	3	2020
11	C 103	Conference hall	2	Blue star	2	Split	3	2023
12	C 101	Guest room	1	Blue star	2	Split	3	2023
13	2	PPT Hall	5	Blue star	4.5	Cassette	1	2016
14	Boys Hostel	Guest house	2	Blue star	2	Split	3	2023
		Total	23					

Observation: It was observed that most of the ACs is star rated. It is appreciable. There is a good potential to install microprocessor based energy saving control system on the above ACs. The detailed energy saving calculations is given in chapter 5.

Energy Audit report prepared by EEPL, Indore, M.P.

Page 51









4.3 Photographs of ACs and fan













Energy Audit report prepared by EEPL, Indore, M.P.

Page 52







CHAPTER-5 ENERGY CONSERVATION MEASURES

This chapter describes the energy conservation measures that can be implemented in a phase manner to optimize energy consumption in the building

ECM: 5.1 Replacement of Conventional FTL (T-8) 36W by LED (T-5) 20W

Sr. No	Items	Parameters	Units
1	Power Consumption by Conventional Tube Light FTL (T-8) 36W	50	Watt
2	No of FTL (T-8)	738	Nos.
3	Working Hours per Day	8	Hrs./Day
4	Working Days per Year	250	Days/Year
5	Rated Power of Energy Efficient LED (T-5)	20	W
6	Energy Saving Potential	44280	kWh/Year
7	Load Factor	80	%
8	Expected Annual Energy Saving	35424	kWh/Year
9	Overall Per Unit Charges for calculation	8.50	Rs./kWh
10	Expected Annual Monetary Saving	3,01,104/-	Rs./Year
11	Cost of LED (T-5)	200/-	Rs./ Piece
12	Investment on New LED Lighting Purchase	1,47,600/-	Rs.
13	Simple Pay Back Period	0.5	Year

ECM: 5.2 Replacement of 4x4 sq fitting (18W*4) by LED sq. fitting

Sr. No	Items	Parameters	Units
1-	Power Consumption by 4x4 sq fitting (PL-4) (18W*4)	72	Watt
2	No of 4x4 fixtures	270	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Rated Power of Energy Efficient 1x1 sq fitting (LED)	36	W
6	Energy Saving Potential	19440	kWh/Year
7	Load Factor	80	%
8	Expected Annual Energy Saving	15552	kWh/Year
9	Overall, Per Unit Charges	8.50	Rs./kWh
10	Expected Money Saving	1,32,192/-	Rs./Year
11	Cost of 1x1 sq. fitting	1000	Rs./ Pices
12	Investment on New Light Purchasing	2,70,000/-	Rs.
13	Simple Path Back Period	2.0	Year

Energy Audit report prepared by EEPL, Indore, M.P.





ECM: 5.3 Replacement of 30W CFL by 15W LED

Sr. No	Items	Parameters	Units
1	Total Power Consumption by CFL	30	Watt
2	No of CFL	25	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
_ 5	Rated Power of Energy Efficient LED	. 15	W
6	Energy Saving Potential	750	kWh/Year
7	Load Factor	100	%
8	Expected Annual Energy Saving	750	kWh/Year
9	Overall, Per Unit Charges	8.50	Rs./kWh
10	Expected Money Saving	6,375/-	Rs./Year
11	Cost of LED	200/-	Rs./ Pices
12	Investment on New Light Purchasing	5,000/-	Rs.
15	Simple Pay Back Period	1	Year

ECM: 5.4 Replacement of 200W CFL by 100W LED

Sr. No	Items	Parameters	Units
1	Total Power Consumption by CFL Gym	200	Watt
2	No of CFL	9	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Rated Power of Energy Efficient LED	100	W
6	Energy Saving Potential	1800	kWh/Year
7	Load Factor	100	%
8	Expected Annual Energy Saving	1800	kWh/Year
9	Overall, Per Unit Charges	8.50	Rs./kWh
10	Expected Money Saving	15,300/-	Rs./Year
11	Cost of LED	1500	Rs./ Pices
12	Investment on New Light Purchasing	13,500	Rs.
13	Simple Pay Back Period	1	Year







ECM: 5.5 Replacement of 18W CFL by 9W LED Down lighter

Sr. No	Items	Parameters	Units
1	Total Power Consumption by CFL	18	Watt
2	No of CFL	26	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Rated Power of Energy Efficient 1x1 sq fitting (LED)	9	W
6 .	Energy Saving Potential	468	kWh/Year
7	Load Factor	100	%
8	Expected Annual Energy Saving	468	kWh/Year
9	Overall, Per Unit Charges	8.50	Rs./kWh
10	Expected Money Saving	3,978/-	Rs./Year
11	Cost of 1x1 sq. fitting	100/-	Rs./ Pices
12	Investment on New Light Purchasing	2600/-	Rs.
13	Simple Pay Back Period	0.7	Year

ECM: 5.6 Replacement conventional Ceiling fans 60W by BLDC fan 28W

Sr. No	Items	Parameters	Units
1	Conventional ceiling fan in the institute	50	Watt
2	No of fans	1013	Nos.
3	Working Hrs./Day	10	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Rated Power consumption of BLDC fan	28	W
6	Energy Saving Potential	55715	kWh/Year
7	Load Factor	100	%
8	Expected Annual Energy Saving	55715	kWh/Year
9	Overall, Per Unit Charges	8.50	Rs./kWh
10	Expected Money Saving	4,73,577/-	Rs./Year
11	Cost of BLDC Fan sq. fitting	2800/-	Rs./ Pices
12	Investment on New Light Purchasing	28,36,400/-	Rs.
13	Simple Pay Rack Period	6.0	Year



Director
Technocrats Institute of Technology
(Excellence)

(Excellence)
Anand Name Dhonal





ECM: 5.7 Installation of Airtron 'intelligent' microprocessor energy saver


Sr. No	Items	Parameters	Units
1	Average power consumption of 1.5 ton AC	1750	Watt
2	No of AC	22	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	200	Days/Year
5	Expected saving @ 30% of power consumption of AC	525	W
8	Expected Annual Energy Saving	18,480	kWh/Year
9	Overall, Per Unit Charges	8.50	Rs./kWh
10	Expected Money Saving	1,57,080/-	Rs./Year
11	Cost of Airtron 'intelligent' microprocessor energy saver	7,500	Rs./ Pices
12	Total Investment on energy saver	1,65,000/-	Rs.
13	Simple Pay Back Period	1.1	Year








ANNEXURE-I: Onsite power measurement

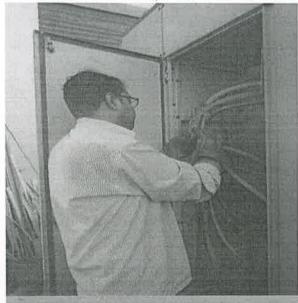



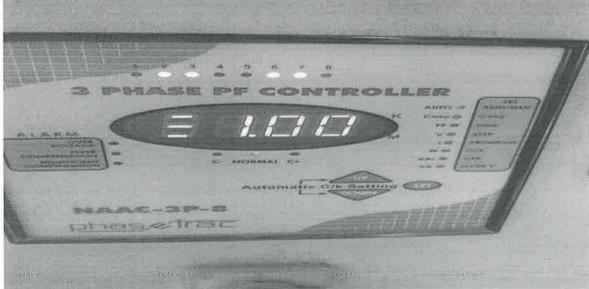







Annexure-II: BLDC ceiling fan product catalog







Annexure-III: Airtron intelligent microprocessor energy saver product catalog

